




PLEASE READ CAREFULLY
and save this document
CONSIDER THE ENVIRONMENT

- EN ENGLISH**
- 230 VAC, 115 VAC or 12-24 VAC/DC power supply (according to the model)
 - analogue input (PTC/NTC/Pt 1000)
 - multi-purpose input
 - K1 relay, 16 A res. @ 250 VAC
 - alarm buzzer
 - TTL MODBUS slave port for TTL/RS-485 serial interface
 - hot or cold mode regulation.

1 MEASUREMENTS AND INSTALLATION


Measurements in mm (inches). To be fitted to a panel, snap-in brackets provided.

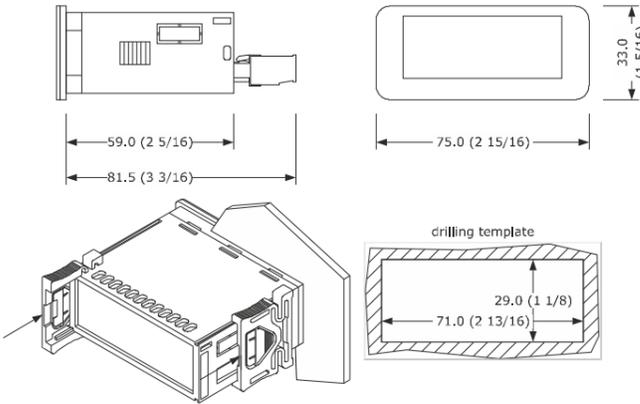

- INSTALLATION PRECAUTIONS**
- the thickness of the panel must be between 0.8 and 2.0 mm (1/32 and 1/16 in);
 - ensure that the working conditions are within the limits stated in the **TECHNICAL SPECIFICATIONS** section;
 - do not install the device close to heat sources, equipment with a strong magnetic field, in places subject to direct sunlight, rain, damp, excessive dust, mechanical vibrations or shocks;
 - in compliance with safety regulations, the device must be installed properly to ensure adequate protection from contact with electrical parts. All protective parts must be fixed in such a way as to need the aid of a tool to remove them.

2 ELECTRICAL CONNECTION

- N.B.**
- Use cables of an adequate section for the current running through them.
 - To reduce any electromagnetic interference connect the power cables as far away as possible from the signal cables.

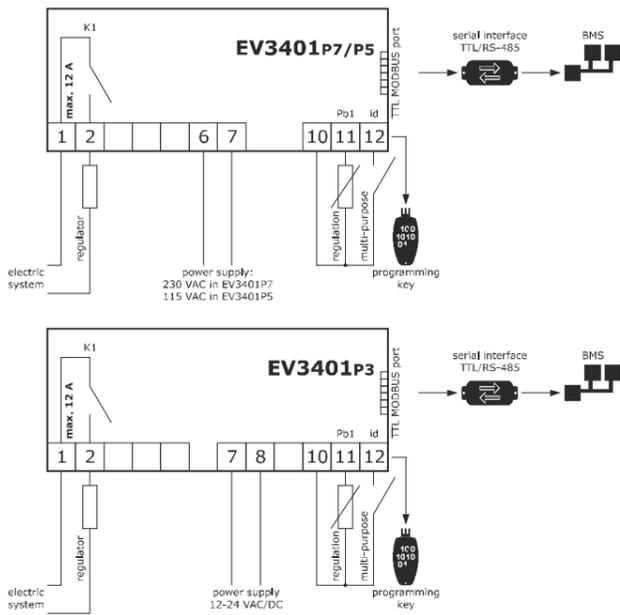

- PRECAUTIONS FOR ELECTRICAL CONNECTION**
- if using an electrical or pneumatic screwdriver, adjust the tightening torque;
 - if the device has been moved from a cold to a warm place, humidity may have caused condensation to form inside. Wait about an hour before switching on the power;
 - make sure that the supply voltage, electrical frequency and power are within the set limits. See the section **TECHNICAL SPECIFICATIONS**;
 - disconnect the power supply before carrying out any type of maintenance;
 - do not use the device as safety device;
 - for repairs and for further information, contact the EVCO sales network.

3 FIRST-TIME USE


1. Install following the instructions given in the section **MEASUREMENTS AND INSTALLATION**.
2. Power up the device as set out in the section **ELECTRICAL CONNECTION**: an internal test will start up. The test normally takes a few seconds; when it is finished the display will switch off.
3. Configure the device as shown in the section **Setting configuration parameters**. Recommended configuration parameters for first-time use.

PAR.	DEF.	PARAMETER	MIN... MAX.
SP	0.0	setpoint 1	r1... r2
P0	0	type of probe	0 = PTC 1 = NTC 2 = Pt 1000 2-wire
P2	0	temperature measurement unit	0 = °C 1 = °F
r5	0	hot or cold mode regulation	0 = cold mode 1 = hot mode

Then check that the remaining settings are appropriate; see the section **CONFIGURATION PARAMETERS**.

4. Disconnect the device from the mains.
5. Make the electrical connection as shown in the section **ELECTRICAL CONNECTION** without powering up the device.
6. When connecting to an RS-485 network, connect the EVIF22TSX interface; see the relevant instruction sheet.
7. Power up the device.

4 USER INTERFACE AND MAIN FUNCTIONS

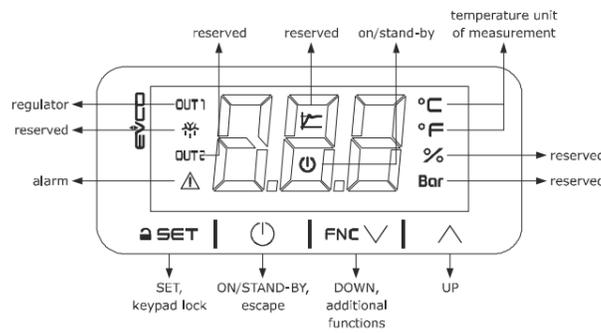

4.1 Switching the device on/off

1. If POF = 1 (default), touch the ON/STAND-BY key for 2 s.
- If the device is switched on, the display will show the P5 value ("regulation temperature" default); if the display shows an alarm code, see the section **ALARMS**.

LED	ON	OFF	FLASHING
OUT1	regulator active	-	- regulator protection active - setpoint being set
OUT2	unused	-	-
Alarm	alarm active	-	-
Device	device switched off	device switched on	device being switched on/off
°C/°F	temperature display	-	-
%	unused	-	-
Bar	unused	-	-

When 30 s have elapsed without the keys being pressed, the display will show the "Loc" label and the keypad will lock automatically.

4.2 Unlocking the keypad

Touch a key for 1 s: the display will show the label "UnL".

4.3 Setting the setpoint

Check that the keypad is not locked.


1. Touch the SET key: the display will show the label "SP".
2. Touch the UP or DOWN key within 15 s to set the value within the limits r1 and r2 (default "0... 35").
3. Touch the SET key (or take no action for 15 s).

4.4 Silencing the buzzer


Touch a key.

5 OPERATION

Cold mode regulation (r5 = 0).

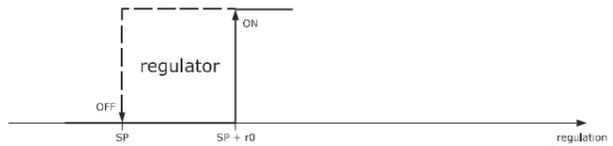

Hot mode regulation (r5 = 1).

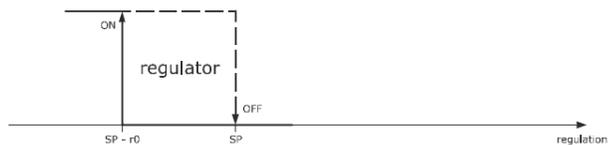

6 ADDITIONAL FUNCTIONS

6.1 Displaying the number of start ups of the relay

Check that the keypad is not locked.

1. Touch the DOWN key for 4 s.
 2. Touch the UP or DOWN key within 15 s to select a label.
- | LAB. | DESCRIPTION |
|------|---|
| nS1 | display of the number of start ups of the K1 relay in thousands |
3. Touch the SET key.
 4. Touch the ON/STAND-BY key (or take no action for 60s) to exit the procedure.

6.2 Displaying the temperature detected by the regulation probe

Check that the keypad is not locked.

1. Touch the DOWN key for 4 s.
 2. Touch the UP or DOWN key within 15 s to select a label.
- | LAB. | DESCRIPTION |
|------|------------------------|
| Pb1 | regulation temperature |
3. Touch the SET key.
 4. Touch the ON/STAND-BY key (or take no action for 60s) to exit the procedure.

7 SETTINGS

7.1 Setting configuration parameters

1. Touch the SET key for 4: the display will show the label "PA".
2. Touch the SET key.
3. Touch the UP or DOWN key within 15 s to set the PAS value (default "-19").
4. Touch the SET key (or take no action for 15 s): the display will show the label "SP".
5. Touch the UP or DOWN key to select a parameter.
6. Touch the SET key.
7. Touch the UP or DOWN key within 15 s to set the value.
8. Touch the SET key (or take no action for 15 s).

9. Touch the SET key for 4 s (or take no action for 60s) to exit the procedure.

7.2 Restoring factory settings (default) and saving customised settings

- N.B.**
- Check that the factory settings are appropriate: see the section **CONFIGURATION PARAMETERS**.
 - saving customised settings overwrites the factory settings.

1. Touch the SET key for 4 s: the display will show the label "PA".
 2. Touch the SET key.
 3. Touch the UP or DOWN key within 15 s to set the value.
- | VAL. | DESCRIPTION |
|------|---|
| 149 | value for restoring factory information (default) |
| 161 | value for saving customised settings |
4. Touch the SET key (or take no action for 15 s): the display will show the label "dEF" (for setting the "149" value) or the label "MAP" (for setting the "161" value)
 5. Touch the SET key.
 6. Touch the UP or DOWN key within 15 s to set "4".
 7. Touch the SET key (or take no action for 15 s): the display will show "- - -" flashing for 4 s, after which the device will exit the procedure.
 8. Disconnect the device from the power supply.
 9. Touch the SET key for 2s before action 6 to exit the procedure beforehand.

8 CONFIGURATION PARAMETERS

No.	PAR.	DEF.	SETPOINT	MIN... MAX.
1	SP	0.0	setpoint	r1... r2
ANALOGUE INPUTS				
2	CA1	0.0	regulation probe offset	-25... 25 °C/°F
3	P0	0	type of probe	0 = PTC 1 = NTC 2 = Pt 1000 2-wire
4	P1	0	enable decimal point °C	0 = no 1 = yes
5	P2	0	temperature measurement unit	0 = °C 1 = °F
6	P5	0	value displayed	0 = regulation temperature 1 = setpoint
7	P8	5	display refresh time	0... 250 s : 10
REGULATION				
8	r0	2.0	setpoint differential	1... 99 °C/°F
9	r1	0.0	setpoint minimum	-99 °C/°F... r2
10	r2	35.0	setpoint maximum	r1... 199 °C/°F
11	r5	0	hot or cold mode regulation	0 = cold mode 1 = hot mode
12	r11	0.0	digital input second setpoint	-99... 199 °C/°F setpoint + r11
REGULATOR PROTECTION				
13	C1	0	minimum time between two power-ons of regulator	0... 240 min
14	C2	0	minimum time off and delay from power-on of regulator	0... 240 min
15	C3	0	minimum time on regulator	0... 240 s
16	C4	0	regulator activity during regulation probe alarm	0 = off 1 = on
ALARMS				
17	A1	0.0	temperature alarm threshold	-99... 199 °C/°F
18	A2	0	temperature alarm type	0 = disabled 1 = absolute minimum 2 = absolute maximum 3 = minimum relative to SP 4 = maximum relative to SP
19	A3	0	temperature alarm delay	0... 999 min
20	A7	0	temperature alarm delay after modifying setpoint and power-on	0... 999 min
21	A8	0	additional alarm signal delay after silencing if the condition persists	0... 999 min
22	A11	2.0	temperature alarm switch off differential	1... 99 °C/°F
DIGITAL INPUTS				
23	i5	0	multi-purpose input function	0 = disabled 1 = alarm iA 2 = alarm iA + regulator off 3 = switches device on/off 4 = modifies setpoint 1
24	i6	0	multi-purpose input activation	0 = with contact closed 1 = with contact open
25	i7	0	multi-purpose input alarm delay	0... 999 s
SECURITY				
26	POF	1	enable ON/STAND-BY key	0 = no 1 = yes
27	PAS	-19	password	-99... 999
MODBUS				
28	LA	247	MODBUS address	1... 247
29	Lb	2	MODBUS baud rate	0 = 2,400 baud 1 = 4,800 baud 2 = 9,600 baud 3 = 19,200 baud even

9 ALARMS

CODE	DESCRIPTION	RESET	TO CORRECT
Pr1	regulation probe alarm	automatic	- check P0 - check probe integrity - check electrical connection
AL	temperature alarm	automatic	check A1, A2 and A3
iA	multi-purpose input alarm	automatic	check i5 and i6

10 TECHNICAL SPECIFICATIONS

Purpose of the control device:	function controller.	
Construction of the control device:	built-in electronic device.	
Container:	black, self-extinguishing.	
Category of heat and fire resistance	D.	
Measurements:		
75.0 x 33.0 x 59.0 mm (2 15/16 x 1 5/16 x 2 5/16 in) with fixed screw terminal blocks	75.0 x 33.0 x 81.5 mm (2 15/16 x 1 5/16 x 3 3/16 in) with plug-in screw terminal blocks.	
Mounting methods for the control device:	to be fitted to a panel, snap-in brackets provided.	
Degree of protection provided by the covering:	IP65 (front).	
Connection method:		
fixed screw terminal blocks for wires up to 2.5 mm ²	plug-in screw terminal blocks for wires up to 2.5 mm ² : on request	Pico-Blade connector.
Maximum permitted length for connection cables:		
power supply: 10 m (32.8 ft)	analogue inputs: 10 m (32.8 ft)	
digital inputs: 10 m (32.8 ft)	digital outputs: 10 m (32.8 ft)	
Operating temperature:	from 0 to 55 °C (from 32 to 131 °F).	

Storage temperature:	from -25 to 70 °C (from -13 to 158 °F).	
Operating humidity:	relative humidity without condensate from 10 to 90%.	
Pollution status of the control device:	2.	
Compliance:		
RoHS 2011/65/EC	WEEE 2012/19/EU	REACH (EU) regulation No 1907/2006
EMC 2014/30/EU	LVD 2014/35/EU.	
Power supply:		
230 VAC (+10% -15%), 50/60 Hz (±3 Hz), max. 2 VA insulated in EV3... P7		
115 VAC (+10% -15%), 50/60 Hz (±3 Hz), max. 2 VA insulated in EV3... P5		
12-24 VAC/DC (+10% -15%), 50/60 Hz (±3 Hz), max. 5 VA/3W in EV3... P3.		
Earthing methods for the control device:	none.	
Rated impulse-withstand voltage:	4 KV with power supply 230 VAC or 115 VAC, 330 V with power supply 12-24 VAC/DC.	
Over-voltage category:	III with power supply 230 VAC or 115 VAC, I with power supply 12-24 VAC/DC.	
Software class and structure:	A.	
Analogue inputs:	1 for PTC, NTC or Pt 1000 probes (regulation probe).	
PTC probes:	Sensor type:	KTY 81-121 (990 Ω @ 25 °C, 77 °F)
	Measurement range:	from -50 to 150 °C (from -58 to 302 °F)
	Resolution:	0.1 °C (1 °F).
NTC probes:	Sensor type:	β3435 (10 KΩ @ 25 °C, 77 °F)
	Measurement range:	from -40 to 105 °C (from -40 to 121 °F)
	Resolution:	0.1 °C (1 °F).
Pt 1000 probes:	Measurement range:	from -100 to 650 °C (from -148 to 999 °F)
	Resolution:	0.1 °C (1 °F).
Digital inputs:	1 dry contact (multi-purpose).	
Dry contact:	Contact type:	5 VDC, 1.5 mA
	Power supply:	none
	Protection:	none.
Digital outputs:	1 with electromechanical relay (K1 relay).	
K1 relay:	SPST, 16 A res. @ 250 VAC.	
Type 1 or Type 2 Actions:	type 1.	
Additional features of Type 1 or Type 2 actions:	C.	
Displays:	LED display, 3 digit, with function icons.	
Alarm buzzer:	built-in.	
Communications ports:	1 TTL MODBUS slave port for TTL/RS-485 serial interface.	

**WARNING**

The device must be disposed of in accordance with local regulations governing the collection of electrical and electronic equipment.

This document and the solutions contained therein are the intellectual property of EVCO and thus protected by the Italian Intellectual Property Rights Code (CPI). EVCO imposes an absolute ban on the full or partial reproduction and disclosure of the content other than with the express approval of EVCO. The customer (manufacturer, installer or end-user) assumes all responsibility for the configuration of the device.

EVCO accepts no liability for any possible errors in this document and reserves the right to make any changes, at any time without prejudicing the essential functional and safety features of the equipment.

**EVCO S.p.A.**Via Feltre 81, 32036 Sedico (BL) ITALY
Tel. +39 0437/8422 | Fax +39 0437/83648

email info@evco.it | web www.evco.it