

DIMENSIONAL DATA

OVERALL DIMENSIONS

The dimensions are expressed in millimetres and inches (third-scale drawing).

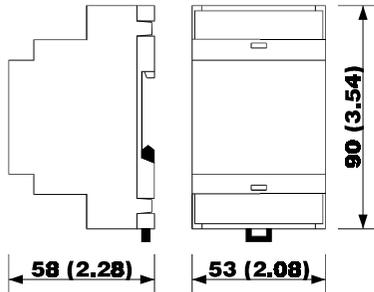


Fig. 3
ds63me.wmf

INSTALLATION

WITH THE FIXING SYSTEM SUGGESTED BY THE BUILDER

On DIN EN 50022 standard rail according with DIN 43880 norms (third-scale drawing).

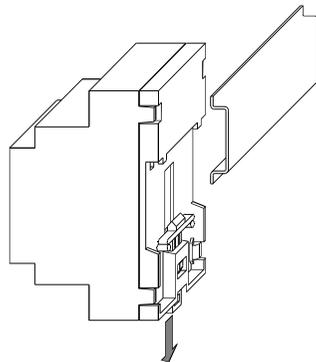


Fig. 4
ms63m.wmf

ELECTRICAL CONNECTION

CONNECTIONS TO DERIVE

Instance of typical application.

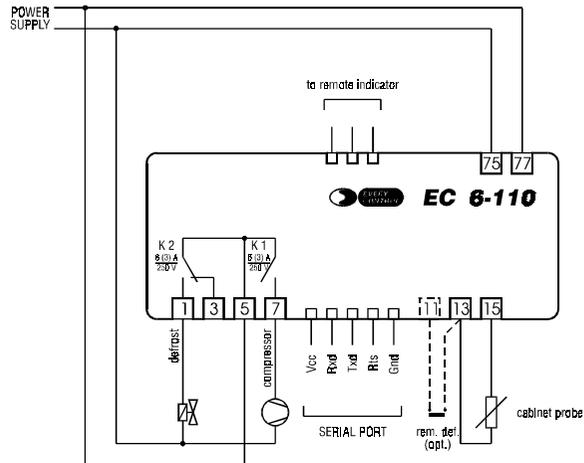


Fig. 5
c6-110e.wmf

BUILDER DATA

EVERY CONTROL S.r.l.

Via Mezzaterra 6, 32036 Sedico Belluno ITALY
Phone 0039/0437852468 (a.r.) Fax 0039/043783648
Internet addresses
e-mail: info@everycontrol.it
http://www.everycontrol.it

TO BE CAREFUL

This publication exclusively belongs to EVERY CONTROL and shall not be reproduced and distributed if not expressly authorized by the same EVERY CONTROL.
EVERY CONTROL does not assume any responsibility in order to the characteristics, to the technical data and to the possible mistakes related herein or deriving from the use of the same.
EVERY CONTROL can not be considered responsible for damages caused from the inobservance of the additional informations.
EVERY CONTROL reserves the right to make any modification without prior notice and at any time without prejudice the basic functioning and safety characteristics.

EC 6-110

ON-OFF digital thermostat for compressor and defrost (for time) management

Operating instructions

Version 1.00 of November the twenty-fourth 2002

File ec6110e_v1.00.pdf

PT

IMPORTANT:

The use of this new instrument is easy; but for safety reasons, it is important read these instructions carefully before the installation or before the use and follow all additional informations.

It is very important keep these instructions with the instrument for future consultations.



Fig. 1
f6-110.wmf

GENERAL INFORMATIONS

WHAT IS THE USE

EC 6-110 is an ON-OFF digital thermostat studied for refrigerating systems management through the compressor and defrost (for time) management.

In factory the instrument gets preset to accept at the measure input PTC/NTC probes used in refrigeration field at the moment.

Some parameters permit to set the thermostat to protect the compressor against overloads due to several starts repeated in a short time, to manage the defrost according with one's requirements, to signal working conditions outside the safety limits.

EC 6-110 is available in the 53 x 90 mm (2.08 x 3.54 in., 3 DIN modules) case and it is studied for DIN standard rail installation.

GETTING STARTED

INSTALLATION

EC 6-110 was studied for DIN EN 50022 standard rail installation according with DIN 43880 norms (the overall dimensions are related in Fig. 3, the fixing system suggested by the builder is related in Fig. 4).

ADDITIONAL INFORMATIONS

- verify if the using conditions (ambient temperature, humidity, etc.) are within the limits indicated by the builder (see the chapter TECHNICAL DATA)
- install the instrument in a location with a suitable ventilation, to avoid the internal overheating of the instrument
- do not install the instrument near surfaces that can obstruct the air-grating (carpets, covers, etc.), heating sources (radiators, hot air ducts, etc.), locations subject to direct sunlight, rain, humidity, excessive dust, mechanical vibrations or bumps, devices with strong magnets (microwave ovens, big speakers, etc.)
- according with the safety norms, the protection against possible contacts with electrical parts and parts protected with functional insulation only must be ensured through a correct installation procedure of the instrument; all parts that ensure the protection must be fixed so that they can not be removed if not with a tool.

ELECTRICAL CONNECTION

EC 6-110 is provided with three screw terminal blocks for cables up to 2.5 mm² (0.38 in.² for the connection to the power supply, measure input and outputs), it is provided with one three poles single line male connector (for the connection to the remote indicator) and it is provided with one five poles single line female connector (for the connection to the CLONE configurator/cloner and RICS supervision systems), located on the instrument frontal panel (the connections to derive are related in Fig. 5 and they are checkable on the polyester label stuck on the instrument case).

ADDITIONAL INFORMATIONS

- if the instrument is brought from a cold to a warm location, the humidity may condense inside the instrument; wait about an hour before supply the instrument
- verify if the operating power supply voltage, electrical frequency and power of the instrument correspond to the local power supply (see the chapter TECHNICAL DATA)
- do not supply more instruments with the same transformer
- if the instrument is installed on a vehicle, its power supply must be derived directly from the battery of the vehicle
- give the instrument a protection able to limit the current absorbed in case of failure
- the instrument remains connected to the local power supply as long as the terminals 75 and 77 are derived to the local power supply, even if the instrument is apparently turned off
- give the probe a protection able to insulate it against possible contacts with metal parts or use insulated probes
- give the outputs a protection able to protect them against short circuit and overload
- do not try to repair the instrument; for the repairs apply to highly qualified staff
- if you have any questions or problems concerning the instrument please consult

Every Control (see the chapter BUILDER DATA).

USE

PRELIMINARY INFORMATIONS

After derived the connections related in Fig. 5, during the normal functioning the instrument displays the temperature read by the cabinet probe.




Fig. 2
iu6120.wmf

If an alarm should be active the instrument displays the alarm code flashing and the buzzer utters an intermittent beep as long as the cause that has given it does not disappear (see the chapter SIGNALS AND ALARMS); pressure on the key T1 during an alarm permits to silence the buzzer.

EC 6-110 is provided with one working setpoint and with some configuration parameters that get stored in a non volatile memory and that permit to set the instrument according with one's requirements (see the chapter CONFIGURABILITY).

The output K 1 is associated to the compressor and to the working setpoint, it remains activated continuously as long as the temperature read by the cabinet probe reaches the working setpoint and when it rises above the working setpoint of the hysteresis value (differential) the output gets reactivated, except during a defrost and a dripping.

Passed the defrost interval from the moment of the instrument start or from the moment in which the instrument presents a request of a defrost cycle the instrument automatically presents the following request of a defrost cycle.

A defrost cycle provides two phases (defrost and dripping) connected in cascade since the end of one automatically determines the passage to the following one.

The output K 2 is associated to the defrost and it remains continuously activated during the defrost.

Passed the defrost length from the moment in which the instrument activates a defrost cycle the defrost ends and the instrument automatically moves to the dripping; if the instrument was set to manage defrost to resistances (electrical) during a defrost the output K 1 gets forced to the status OFF, if the instrument was set to manage hot gas defrost (reversal of cycle) during a defrost the output K 1 remains continuously activated.

Passed the dripping length from the moment of the defrost end the defrost cycle ends; during a dripping the output K 1 gets forced to the status OFF.

Keeping pushed the key T2 for four seconds at least or activating the remote defrost digital input (available on request) the instrument presents a request of a defrost cycle.

WORKING SETPOINT SETTING (WORKING TEMPERATURE)

To modify the working setpoint value keep pushed the key T3 (the instrument displays the actual value) and at the same time push and release over and over the key T1 or T2 as long as the instrument displays the desired value (keeping pushed the key T1 or T2 the value gets decreased or increased more quickly); after the modification release the key T3 last; during the pressure of the key T3 the LED L1 flashes quickly to indicate that a working setpoint setting procedure is running (to the release of the key T3 the instrument automatically turns out from the working setpoint setting procedure).

ADDITIONAL INFORMATIONS

- for the whole period of a corrupted memory data alarm the access to the working setpoint setting procedure is refused
- the working setpoint is programmable within the limits established with the parameters r1 and r2

- *the working setpoint value gets stored in a non volatile memory even if a lack of power supply happens.*

CONFIGURATION PARAMETERS SETTING

Configuration parameters are arranged on two levels, to protect the most tricky settings against undesirable violations and they are arranged in families that can be recognized through the initial letter of the label.

To gain access to the first level keep pushed at the same time for four seconds at least the keys **T1** and **T2** (passed four seconds the instrument displays the label **PA**).

To select a parameter of the first level push and release over and over the key **T1** or **T2** as long as the instrument displays the label of the desired parameter.

To modify the parameter value keep pushed the key **T3** (the instrument displays the actual value) and at the same time push and release over and over the key **T1** or **T2** as long as the instrument displays the desired value (keeping pushed the key **T1** or **T2** the value gets decreased or increased more quickly); after the modification release the key **T3** last (to the release of the key **T3** the instrument displays the label of the parameter again).

To gain access to the second level enter inside the first level and select the label **PA**.

Keep pushed the key **T3** (the instrument displays the actual value) and at the same time push and release over and over the key **T1** or **T2** as long as the instrument displays -19 (keeping pushed the key **T1** or **T2** the value gets decreased or increased more quickly); after the modification release the key **T3** last (to the release of the key **T3** the instrument displays the label **PA** again); keep pushed at the same time for four seconds at least the keys **T1** and **T2** (passed four seconds the instrument displays the first parameter of the second level).

To select a parameter of the second level push and release over and over the key **T1** or **T2** as long as the instrument displays the label of the desired parameter.

To modify the parameter value keep pushed the key **T3** (the instrument displays the actual value) and at the same time push and release over and over the key **T1** or **T2** as long as the instrument displays the desired value (keeping pushed the key **T1** or **T2** the value gets decreased or increased more quickly); after the modification release the key **T3** last (to the release of the key **T3** the instrument displays the label of the parameter again).

To turn out from the configuration parameters setting procedure keep pushed at the same time for four seconds at least the keys **T1** and **T2** or do not operate with the keys for fifty seconds at least (time-out exit).

ADDITIONAL INFORMATIONS

- *for the whole period of a corrupted memory data alarm the access to the configuration parameters setting procedure is refused*
- *the modification of a parameter value which unit of measure is the hour or the minute or the second has not immediate effect; to obtain this effect it must not be executed during the course of the value*
- *the configuration parameters values get stored in a non volatile memory even if a lack of power supply happens.*

CONFIGURABILITY

WORKING SETPOINT

LABEL	MIN.	MAX.	U.M.	ST.	WORKING SETPOINT
r1	r2	°C	+2		working setpoint

It establishes the temperature associated to the output K 1.

CONFIGURATION PARAMETERS

LABEL	MIN.	MAX.	U.M.	ST.	PASSWORD
PA	-55	99	---	0	passwd (\$)

It is the password that permits to gain access to the second level.

LABEL	MIN.	MAX.	U.M.	ST.	MEASURE INPUT
/0	1	4	---	1	kind of probe

It establishes the kind of probe that the instrument must recognize to its measure input, as indicated:

- 1 = PTC probe
- 2 = reserved
- 3 = NTC probe
- 4 = reserved.

/1	-55	+99	°C/0	0	calibration
----	-----	-----	------	---	-------------

It establishes a threshold to add algebraically to the signal coming from the measure input (for instance to correct the signal).

/2	0	6	---	3	digital filter
----	---	---	-----	---	----------------

It establishes a time constant to apply to the signal coming from the measure input, as indicated:

- 0 = 0 sec.
- 1 = 0.4 sec.
- 2 = 1.2 sec.
- 3 = 3.0 sec.
- 4 = 8.0 sec.
- 5 = 19.8 sec.
- 6 = 48.0 sec.

/3	---	---	---	---	reserved
----	-----	-----	-----	-----	----------

Reserved.

LABEL	MIN.	MAX.	U.M.	ST.	ON-OFF TEMPERATURE REGULATOR ASSOCIATED TO THE WORKING SETPOINT AND TO THE OUTPUT K 1
r0	+1	+15	°C	+2	hysteresis (differential) (\$)

It establishes the hysteresis (differential) relative to the working setpoint.

r1	-55	+99	°C	-50	minimum working setpoint programmable
----	-----	-----	----	-----	---------------------------------------

It establishes the minimum working setpoint programmable; the instrument automatically verifies if the value established with the parameter r1 is below the maximum working setpoint programmable established with the parameter r2.

r2	-55	+99	°C	+50	maximum working setpoint programmable
----	-----	-----	----	-----	---------------------------------------

It establishes the maximum working setpoint programmable; the instrument automatically verifies if the value established with the parameter r2 is above the minimum working setpoint programmable established with the parameter r1.

LABEL	MIN.	MAX.	U.M.	ST.	OUTPUT K 1 PROTECTION
C0	0	15	min.	0	disabling time to the output activation from the instrument start

2

It establishes the time that disables the output activation from the moment of the instrument start.

C1	0	15	min.	5	disabling time to the output activation from the previous activation
----	---	----	------	---	--

It establishes the time that disables the output activation from the moment of the previous output activation.

C2	0	15	min.	3	disabling time to the output activation from the previous deactivation
----	---	----	------	---	--

It establishes the time that disables the output activation from the moment of the previous output deactivation.

C3	0	1	---	0	output status during a cabinet probe failure alarm
----	---	---	-----	---	--

It establishes the status to which the output gets forced during a cabinet probe failure alarm, as indicated:

- 0 = during a cabinet probe failure alarm the output gets forced to the status OFF
- 1 = during a cabinet probe failure alarm the output gets forced to the status ON.

C4	0	1	---	0	disabling time to the output activation and deactivation
----	---	---	-----	---	--

It establishes if to disable the output activation and deactivation for a fixed time, as indicated:

- 0 = inactive
- 1 = the output activation and deactivation get disabled for 3 sec.

LABEL	MIN.	MAX.	U.M.	ST.	DEFROST REGULATOR
d0	0	99	(*)	8	defrost interval

It establishes the time interval that pass from the moment of the instrument start or from the moment in which the instrument presents a request of a defrost cycle to the moment in which the instrument automatically presents the following request of a defrost cycle.

If the parameter d0 has value 0 the instrument never automatically presents a request of a defrost cycle, except what established with the parameter d4.

d1	0	1	---	0	kind of defrost
----	---	---	-----	---	-----------------

It establishes the kind of defrost that the instrument must manage, as indicated:

- 0 = to resistances (electrical)
- 1 = to hot gas (reversal of cycle).

d3	1	99	(*)	30	defrost length
----	---	----	-----	----	----------------

It establishes the defrost length.

d4	0	1	---	0	defrost cycle at the instrument start
----	---	---	-----	---	---------------------------------------

It establishes if the instrument automatically must present a request of a defrost cycle at the moment of the instrument start, as indicated:

- 0 = inactive
- 1 = the instrument automatically presents a request of a defrost cycle at the moment of the instrument start.

d5	0	99	(*)	0	delay to a defrost cycle activation from the instrument start
----	---	----	-----	---	---

If the parameter d4 has value 0 it establishes a time interval to add to the interval established with the parameter d0; the value so obtained establishes the time interval that pass from the moment of the instrument start to the moment in which the instrument automatically presents the following request of a defrost cycle.

If the parameter d4 has value 1 it establishes the delay with which the instrument automatically presents a request of a defrost cycle from the moment of the instrument start.

A manual presentation of a request of a defrost cycle during the count of the delay established with the parameter d5 clears the delay.

d6	0	1	---	1	locking of the displayed temperature from a defrost cycle activation
----	---	---	-----	---	--

It establishes if to lock the displayed temperature from the moment in which the instrument activates a defrost cycle, as indicated:

- 0 = inactive
- 1 = during a defrost, a dripping and as long as the temperature read by the cabinet probe reaches the working setpoint, the instrument displays the temperature read by the cabinet probe in the moment in which the instrument activates a defrost cycle.

d7	0	15	(*)	2	dripping length
----	---	----	-----	---	-----------------

It establishes the dripping length.

d8	0	15	hours	1	disabling time to the temperature alarm activation from the defrost cycle end
----	---	----	-------	---	---

It is significant exclusively if the parameter db has value 0, it establishes the time that disables the temperature alarm activation from the moment of the defrost cycle end.

d9	0	1	---	0	disabling times to the output K 1 activation override
----	---	---	-----	---	---

It is significant exclusively if the parameter d1 has value 1, it establishes if to clear the disabling times to the output K 1 activation in the moment in which the instrument presents a request of a defrost cycle, as indicated:

- 0 = inactive
- 1 = in the moment in which the instrument presents a request of a defrost cycle the disabling times to the output K 1 activation get cleared.

db	0	1	---	0	times base for the parameters d0, d3, d5 and d7
----	---	---	-----	---	---

It establishes the unit of measure of the parameters d0, d3, d5 and d7, as indicated:

- 0 = the unit of measure of the parameter d0 is the hour and the unit of measure of the parameters d3, d5 and d7 is the minute
- 1 = the unit of measure of the parameter d0 is the minute and the unit of measure of the parameters d3, d5 and d7 is the second.

LABEL	MIN.	MAX.	U.M.	ST.	TEMPERATURE ALARM REGULATOR
A0	+1	+15	°C	+2	hysteresis (differential)

It establishes the hysteresis (differential) relative to the parameters A1 and A2.

A1	-55	0	°C	-10	lower alarm set relative to the working setpoint
----	-----	---	----	-----	--

It establishes a threshold to add algebraically to the working setpoint; the value so obtained establishes the temperature below which the lower temperature alarm gets activated.

A2	0	+99	°C	+10	upper alarm set relative to the working setpoint
----	---	-----	----	-----	--

It establishes a threshold to add algebraically to the working setpoint; the value so obtained establishes the temperature above which the upper temperature alarm gets activated.

2

If the parameter A2 has value 0 the upper temperature alarm never gets activated.

A3	0	15	hours	2	disabling time to the alarm activation from the instrument start
----	---	----	-------	---	--

It establishes the time that disables the temperature alarm activation from the moment of the instrument start.

A4	---	---	---	---	reserved
----	-----	-----	-----	-----	----------

Reserved.

LABEL	MIN.	MAX.	U.M.	ST.	CONNECTION IN A SERIAL NETWORK WITH EVCOBUS PROTOCOL COMMUNICATION
L0	---	---	---	---	reserved

Reserved.

L1	1	15	---	1	instrument address
----	---	----	-----	---	--------------------

It establishes the address to which the instrument (slave) answers when it is connected to a serial network with EVCOBUS protocol communication managed from a master (for instance a Personal Computer).

ADDITIONAL INFORMATIONS

- *the symbol (\$)* indicates that the parameter is of the first level
- *the symbol (*)* indicates that the unit of measure depends from the parameter db.

SIGNALS AND ALARMS

SIGNALS

If the LED **L1** is turned ON it means that the output K 1 is activated.

If the LED **L2** is turned ON it means that the output K 2 is activated.

If the LED **L1** flashes it means that a count of a disabling time to the output K 1 activation is running (see the parameters C0, C1, C2 and C4).

If the LED **L2** flashes it means that a count of a delay time to a defrost cycle activation is running (see the parameters C0, C1, C2 and C4) or that a dripping is running (see the parameter d7).

ALARMS

If the instrument displays the indication "**E2**" flashing and the buzzer utters an intermittent beep (**corrupted memory data alarm**) it means that there is a corruption of the configuration data in the memory (turn OFF and turn ON again the instrument: if to the turning ON again the alarm does not disappear the instrument must be replaced); during this alarm the access to the working setpoint setting and the configuration parameters setting procedure is refused and all outputs get forced to the status OFF.

If the instrument displays the indication "**E0**" flashing and the buzzer utters an intermittent beep (**cabinet probe failure alarm**) it means that: the kind of connected cabinet probe is not proper (see the parameter /0), the cabinet probe is faulty (verify the cabinet probe integrity), there is a mistake in the instrument-cabinet probe connection (verify the instrument-cabinet probe connection integrity), the temperature read by the cabinet probe is outside the limits permitted by the cabinet probe in use (verify that the temperature near the cabinet probe be inside the limits permitted by the cabinet probe); during this alarm the output K 1 gets forced to the status established with the parameter C3, if a defrost cycle is running the defrost cycle ends and the instrument never activates a defrost cycle.

If the instrument displays the temperature read by the cabinet probe flashing and the buzzer utters an intermittent beep (**temperature alarm**) it means that the temperature read by the cabinet probe is outside the limit established with the parameter A1 or A2 (see the parameters A0, A1 and A2); inactive.

If the instrument displays the indication "**99**" flashing (**end of scale display**) it means that the temperature read by the cabinet probe is outside the working range permitted by the instrument (verify that the temperature near the cabinet probe be inside the limits permitted by the instrument); inactive.

ADDITIONAL INFORMATIONS

- *the alarm codes are related in order of precedence*
- *during a defrost cycle the temperature alarm is disabled.*

TECHNICAL DATA

TECHNICAL DATA

Case: plastic grey (PP0), self-extinguishing.
Size: 53 x 90 x 58 mm (2.08 x 3.54 x 2.28 in., 3 DIN modules).
Installation: on DIN EN 50022 standard rail installation according with DIN 43880 norms.

Type of protection: IP 40.

Connections: screw terminal blocks with pitch 5.08 mm (0.2 in., power supply, measure input and outputs) for cables up to 2.5 mm² (0.38 in.²), three poles single line male connector with pitch 2.5 mm (0.09 in., to remote indicator, the maximum distance that can be interfaced is 50 m, 164.04 ft.), five poles single line female connector with pitch 2.5 mm (0.09 in., serial port).

Ambient temperature: from 0 to +60 °C (+32 to +140 °F, 10 ... 90 % of not condensing relative humidity).

Power supply: 230 Vac or 115 Vac, 50/60 Hz, 2 VA.

Insulation class: II.

Alarm buzzer: incorporated.

Measure inputs: 1 configurable for PTC/NTC probes.

Working range: from -50 a +99 °C (-58 to +99 °F) for PTC probe, from -40 to +99 °C (-40 to +99 °F) for NTC probe.

from -55 to +99 °C (-55 to +99 °F).
 1 °C (1 °F).

Display: 2-digit display 12.5 mm (0.49 in.) high red LED display with automatic minus sign, output status indicators.

Outputs: two 6 (3) A @ 250 Vac relays for one ½ HP @ 250 Vac compressor (NO contact) and defrost system

3

(change-over contact) management.

to resistances (electrical) and to hot gas (reversal of cycle), automatic and manual.

Defrost management: for interval and length.

Serial port: TTL with EVCOBUS protocol communication, for the connection to the CLONE configurator/cloner and RICS supervisory systems.

3

HOW TO ORDER

CODING SYSTEM

Instrument name: EC 6-110.
Desired measure input: P (for PTC/NTC probes).
Desired power supply: 220 (230 Vac)
 115 (115 Vac).