

FK 501T

ON-OFF two outputs digital humidity/pressure regulator

Version 1.00 of July the second, 2002

File fk501te_v1.00.pdf

PT

EVERY CONTROL S.r.l.

This Company belongs to **EVCO group**

Via Mezzaterra 6, 32036 Sedico Belluno ITALY

Phone 0039-0437-852468 • Fax 0039-0437-83648

info@everycontrol.it • www.everycontrol.it


ENGLISH

smart guide

1 PREPARATIONS


1.1 How to install the instrument

Panel mounting, panel cut out 71 x 29 mm (2.79 x 1.14 in), with click brackets (they are supplied by the builder) or screw brackets (by request).

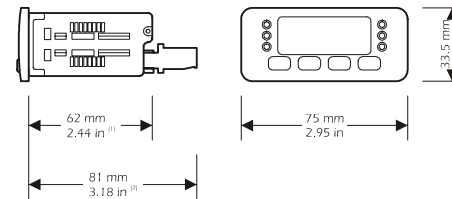

(1) maximum depth with screw terminal blocks (by request)

(2) maximum depth with extractable terminal blocks (standard model).

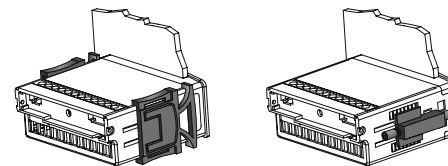

installation with click brackets (on the left-hand side, they are supplied by the builder)

and screw brackets (on the right-hand side, by request); if you are using screw brackets, you have to moderate the clamping torque, in order not to damage the box and screw brackets.

2 OPERATION

2.1 Preliminary information

During the normal operation the instrument shows the process variable.

3 WORKING SETPOINT

3.1 How to set the working setpoint

If you have to modify the first working setpoint value:

- press **set**
- press **↑** or **↓** within 2 s ⁽³⁾ ⁽⁴⁾
- do not operate for 2 s ⁽⁵⁾

If you have to modify the second working setpoint value:

- press **set** during the first working setpoint modification
- press **↑** or **↓** within 2 s ⁽⁵⁾ ⁽⁶⁾ ⁽⁷⁾
- press **set**

(3) you can set the first working setpoint between the limits you have set with the parameters rA1 and rA2

(4) unless the parameter rA5 has value 0, you can not modify the first working setpoint

(5) if the parameter -/0 has value 3, the second working setpoint will not be showed

(6) you can set the second working setpoint between the limits you have set with the parameters rb1 and rb2

(7) unless the parameter rb5 has value 0, you can not modify the second working setpoint.

4 CONFIGURATION PARAMETERS

4.1 How to set the configuration parameters

Configuration parameters are arranged on two levels.

If you have to gain access the first level:

- press **↑** and **↓** for 4 s ⁽¹⁾; the instrument will show **PR**

If you have to select a parameter:

- press **↑** or **↓**

If you have to modify the value of the parameter:

- press **set**
- press **↑** or **↓** within 2 s ⁽²⁾
- press **set**

If you have to gain access the second level:

- gain access the first level
- press or for selecting *PR*
- press within 2 s for setting “-19”
- press for 4 s : the instrument will show -P0
- press and for 4 s or do not operate for about 60 s.

If you have to quit the procedure:

- press and for 4 s or do not operate for about 60 s.

5 SIGNALS

5.1 Signals

LED	MEANING
out 1	Load 1 LED if it is lighted, the load 1 will be ON if it flashes, a load 1 delay will be running (look at the parameters CA0, CA1, CA2 and CA4)
out 2	Load 2 LED if it is lighted, the load 2 will be ON if it flashes, a load 2 delay will be running (look at the parameters Cb0, Cb1, Cb2 and Cb4)
%r.H.	Relative humidity LED if it is lighted, the unit of measure of the process variable is relative humidity
bar	Bar LED if it is lighted, the unit of measure of the process variable is bar

INDICAT.	MEANING
---	you can not modify the working setpoint (look at the parameters rA5 and/or rb5)

6 ALARMS

6.1 Alarms

CODE	REASONS	REMEDIES	EFFECTS
E2	there is the corruption of the configuration data of the memory of the instrument	switch off the power supply of the instrument: unless the alarm disappears, you will have to change the instrument	you can not gain access the setting procedures all outputs will be forced OFF
E0	<ul style="list-style-type: none"> the kind of room probe you have connected is not right the room probe plays up the connection instrument-room probe is wrong the process variable is outside the limits allowed by the working range of the instrument 	<ul style="list-style-type: none"> look at the parameter /0 test the integrity of the probe test the instrument-probe connection test the process variable close to the probe (it has to be between the limits allowed by the working range) 	<ul style="list-style-type: none"> the load 1 will be forced to the status you have set with the parameter CA3 the load 2 will be forced to the status you have set with the parameter Cb3
AL1	the process variable is first outside the limit you have set with the parameter AA1	test the process variable close to the probe (look at the parameters AA0, AA1 and AA4)	no effects
AL2	the process variable is second outside the limit you have set with the parameter Ab1	test the process variable close to the probe (look at the parameters Ab0, Ab1 and Ab4)	no effects

LABEL	MIN.	MAX.	U.M.	DEF.	SERIAL NETWORK (EVCOBUS)
L1	1	15	—	1	instrument address
L2	0	7	—	0	instrument group
L4	0	3	—	1	baud rate (0 = 1,200 baud, 1 = 2,400 baud, 2 = 4,800 baud, 3 = 9,600 baud)

(8) the unit of measure depends on the parameter /d

(9) if the parameter /0 has value 3, the parameter will not be showed

(10) if the parameter rA3 has value 0, you have to set the parameter rA0 with positive sign; if the parameter rA3 has value 1, you have to set the parameter rA0 with negative sign

(11) if the parameter /0 has value 3, the parameter will set the neutral zone value

(12) if the parameter rb3 has value 0, you have to set the parameter rb0 with positive sign; if the parameter rb3 has value 1, you have to set the parameter rb0 with negative sign

(13) if the parameter has value 3, the load 1 will be ON when the process variable will rise above the value “first working setpoint + rA0” and the load 2 will be ON when the process variable will fall below the value “first working setpoint - rA0” (the loads will be ON as long as the process variable will get the first working setpoint)

(14) if the parameter /9 has value 0, the parameter will not be showed

(15) the value depends on the range of the transducer the instrument has been preset


(16) if the parameter has value 3 or 4, press to show the process variable

(17) if the immediate change of the process variable is minor than the one you have set with the parameter, the process variable will be updated every 7.5 s by an algorithm of the instrument

(18) if the parameter has value 2, no LED will indicate the unit of measure of the process variable.

9 ELECTRICAL CONNECTION

9.1 Electrical connection

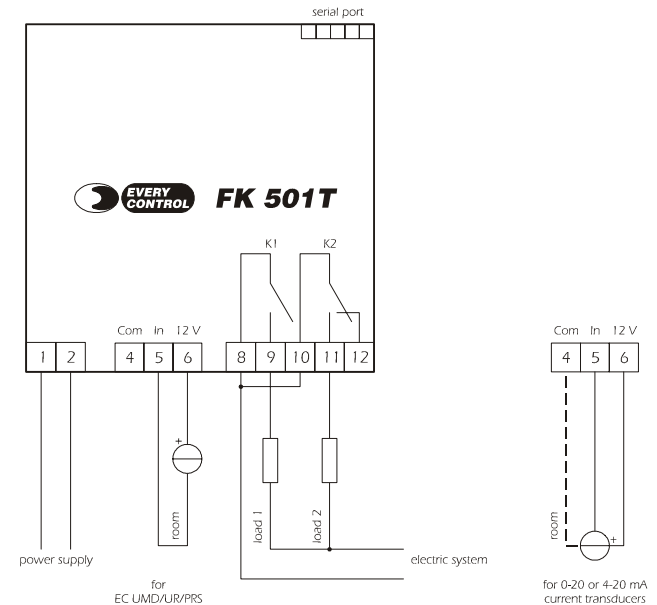

LABEL	MIN.	MAX.	U.M.	DEF.	LOAD 1 PROTECTION
CA0	0	999	s	0	minimum delay between you turn the instrument ON and the first load 1 activation
CA1	0	999	s	0	minimum delay between two load 1 activation in succession
CA2	0	999	s	0	minimum delay between the load 1 gets OFF and the following activation
CA3	0	1	—	0	load 1 status during the room probe alarm (0 = it will be forced OFF; 1 = it will be forced ON)
CA4	0	1	—	0	fixed delay since the load 1 gets ON and OFF (1 = YES, for 3 s)

LABEL	MIN.	MAX.	U.M.	DEF.	LOAD 2 PROTECTION
Cb0	0	999	s	0	minimum delay between you turn the instrument ON and the first load 2 activation
Cb1	0	999	s	0	minimum delay between two load 2 activation in succession
Cb2	0	999	s	0	minimum delay between the load 2 gets OFF and the following activation
Cb3	0	1	—	0	load 2 status during the room probe alarm (0 = it will be forced OFF; 1 = it will be forced ON)
Cb4	0	1	—	0	fixed delay since the load 2 gets ON and OFF (1 = YES, for 3 s)

LABEL	MIN.	MAX.	U.M.	DEF.	FIRST ALARM
AA0	0.1	999	%r.H./bar [®]	0.1	hysteresis (differential, it is relative to AA1, it is important if AA4 ≠ 1)
AA1	-99	999	%r.H./bar [®]	0.0	first process variable alarm threshold (it is important if AA4 ≠ 1); look at AA4 as well
AA3	0	999	min	0	first process variable alarm exclusion time since you turn the instrument ON (it is important if AA4 ≠ 1)
AA4	1	7	—	1	kind of process variable alarm (1 = it will never be activated, 2 = absolute lower process variable alarm, 3 = absolute upper process variable alarm, 4 = lower process variable alarm relative to the first working setpoint, 5 = upper process variable alarm relative to the first working setpoint, 6 = lower process variable alarm relative to the first working setpoint with automatic calculation and enabling, 7 = upper process variable alarm relative to the first working setpoint with automatic calculation and enabling)

LABEL	MIN.	MAX.	U.M.	DEF.	SECOND ALARM
Ab0	0.1	999	%r.H./bar [®]	0.1	hysteresis (differential, it is relative to Ab1, it is important if Ab4 ≠ 1)
Ab1	-99	999	%r.H./bar [®]	0.0	second process variable alarm threshold (it is important if Ab4 ≠ 1); look at Ab4 as well
Ab3	0	999	min	0	second process variable alarm exclusion time since you turn the instrument ON (it is important if Ab4 ≠ 1)
Ab4	1	7	—	1	kind of process variable alarm (1 = it will never be activated, 2 = absolute lower process variable alarm, 3 = absolute upper process variable alarm, 4 = lower process variable alarm relative to the first working setpoint, 5 = upper process variable alarm relative to the first working setpoint, 6 = lower process variable alarm relative to the first working setpoint with automatic calculation and enabling, 7 = upper process variable alarm relative to the first working setpoint with automatic calculation and enabling)

SAT	the process variable is saturation of the display	test the process variable close to the probe (look at the parameters /3, /9, /r and rA7)	<ul style="list-style-type: none"> if the parameter /9 has value 1, the instrument will work as if the process variable were always the value you have set with the parameter rA7 if the parameter /9 has value 3 or 4, the instrument will not consider process variable values above the one you have set with the parameter /7
	<p>process variable/first working setpoint value</p> <p>process variable out of scale</p>	test the process variable close to the probe (look at the parameters /9, /r, rA6 and rA7)	<ul style="list-style-type: none"> if the parameter /9 has value 1, the instrument will work as if the process variable were always the value you have set with the parameter rA6 or rA7 if the parameter /9 has value 3 or 4, the instrument will not consider process variable values below the one you have set with the parameter /6 and above the one you have set with the parameter /7

The instrument shows the indications above alternated with the process variable, except the indications "E2", "EO" and "SAT" (they flash).

7 TECHNICAL DATA

7.1 Technical data

Box: self-extinguishing grey.

Size: 75 x 33.5 x 81 mm (2.95 x 1.31 x 3.18 in) the model with extractable terminal blocks (standard model), 75 x 33.5 x 62 mm (2.95 x 1.31 x 2.44 in) the model with screw terminal blocks (by request).

Installation: panel mounting, panel cut out 71 x 29 mm (2.79 x 1.14 in), with click brackets (they are supplied by the builder) or screw brackets (by request).

Frontal protection: IP 65.

Connections: extractable terminal blocks with pitch 5 mm (0.19 in, standard model) for cables up to 2.5 mm² (0.38 sq in, power supply, input and outputs) or screw terminal blocks with pitch 5 mm (0.19 in, by request) for cables up to 2.5 mm² (0.38 sq in, power supply, input and outputs), 5 poles single line male connector with pitch 2.5 mm (0.09 in, serial port).

Ambient temperature: from 0 to 55 °C (32 to 131 °F; 10 ... 90% of relative humidity without condensate).

Power supply: 230 Vac, 50/60 Hz, 1.5 VA (standard model) or 115 Vac, 50/60 Hz, 1.5 VA (by request).

Measure inputs: 1 (room probe) for 0-20 or 4-20 mA current transducers.

At terminal 6 there are 12 V you can use in order to supply the transducer.

Working range: configurable (it depends on the range of the transducer).

Setpoint range: from -99 to 999 %r.H./bar.

Resolution: 0.1 or 1 %r.H./bar.

Display: one red LED 3-digit display 13.2 mm (0.51 in) high, output status indicators, process variable unit of measure indicators.

Outputs: 2 relays: one 8 A @ 250 Vac relay for load 1 control (NO contact) and one 8 A @ 250 Vac relay for load 2 control (change-over contact).

Serial port: TTL with EVCBUS communication protocol (for the configurator/cloner system CLONE and supervision system RICS).

8 WORKING SETPOINT AND CONFIGURATION PARAMETERS

8.1 Working setpoint

LABEL	MIN.	MAX.	U.M.	DEF.	WORKING SETPOINT
rA1	rA2	%r.H./bar ⁽⁹⁾	0.0		first working setpoint
rb1	rb2	%r.H./bar ⁽⁹⁾	0.0		second working setpoint ⁽⁹⁾

8.2 First level parameters

LABEL	MIN.	MAX.	U.M.	DEF.	PASSWORD
PA	-90	100	—	0	password

LABEL	MIN.	MAX.	U.M.	DEF.	MEASURE INPUTS
/1	-25	25.0	%r.H./bar ⁽⁹⁾	0.0	room probe calibration

LABEL	MIN.	MAX.	U.M.	DEF.	FIRST REGULATOR
rA0	-99	99.9	%r.H./bar ⁽⁹⁾	-0.2	hysteresis (differential, it is relative to the first working setpoint); look at rA4 as well ⁽¹⁰⁾ ⁽¹¹⁾

LABEL	MIN.	MAX.	U.M.	DEF.	SECOND REGULATOR
rb0	-99	99.9	%r.H./bar ⁽⁹⁾	-0.2	hysteresis (differential, it is relative to the second working setpoint); look at rb4 as well ⁽⁹⁾ ⁽¹²⁾

8.3 Second level parameters

LABEL	MIN.	MAX.	U.M.	DEF.	KIND OF REGULATOR
-/0	1	3	---	2	kind of regulator (1 = the first working setpoint is absolute, the second one is relative to the first, 2 = two absolute working setpoint, 3 = neutral zone) ⁽¹³⁾

LABEL	MIN.	MAX.	U.M.	DEF.	MEASURE INPUTS
/0	30	31	—	30	kind of probe (30 = 4-20 mA, 31 = 0-20 mA)
/1	-25	25.0	%r.H./bar ⁽⁹⁾	0.0	room probe calibration
/2	0	6	—	3	probe reading speed (0 = fast, ..., 6 = slow)
/3	0	1	—	0	indication "SAI" flashing on the display during the saturation of the display (it is important if /9 ≠ 0; 1 = YES) ⁽¹⁴⁾
/5	0	1	—	1	process variable resolution (0 = 1 %r.H./bar, 1 = 0.1 %r.H./bar)
/6	-99	999	points	⁽¹⁵⁾	minimum value of the range of the transducer
/7	-99	999	points	⁽¹⁵⁾	maximum value of the range of the transducer
/9	0	4	—	0	display mode (0 = during the normal operation the instrument shows the process variable, 1 = during the normal operation the instrument shows the process variable, as soon as the process variable falls below the threshold you have set with the parameter rA6 or rises above the threshold you have set with the parameter rA7 the instrument will show the value of the threshold flashing and the instrument will work as if the process variable were always the value you have set with the parameter rA6 or with the parameter rA7, 2 = during the normal

					operation the instrument shows the process variable, as soon as the process variable falls below the threshold you have set with the parameter rA6 or rises above the threshold you have set with the parameter rA7 the instrument will show the value of the threshold flashing, 3 = during the normal operation the instrument shows the first working setpoint value, as soon as the process variable falls below the threshold you have set with the parameter rA6 or rises above the threshold you have set with the parameter rA7 the instrument will show the first working setpoint value flashing, the instrument will not consider process variable values below the one you have set with the parameter /6 and above the one you have set with the parameter /7, 4 = during the normal operation the instrument shows the first working setpoint value, as soon as the process variable falls below the threshold you have set with the parameter rA6 or rises above the threshold you have set with the parameter rA7 the instrument will show the process variable flashing, the instrument will not consider process variable values below the one you have set with the parameter /6 and above the one you have set with the parameter /7) ⁽¹⁶⁾
/b	0.0	25.0	%r.H./bar ⁽⁹⁾	0.0	minimum immediate change of the process variable in order that it can immediately be considered by the instrument (0.0 = the function will not be enabled) ⁽¹⁷⁾
/d	0	2	—	1	process variable unit of measure (0 = bar, 1 = %r.H., 2 = dimensionless) ⁽¹⁸⁾
/r	0	1	—	0	kind of process variable value the instrument freezes the display (kind of rA6 and rA7, it is important if /9 ≠ 0; 0 = absolute, 1 = relative to the first working setpoint) ⁽¹⁴⁾

LABEL	MIN.	MAX.	U.M.	DEF.	FIRST REGULATOR
rA0	-99	99.9	%r.H./bar ⁽⁹⁾	-0.2	hysteresis (differential, it is relative to the first working setpoint); look at rA4 as well ⁽¹⁰⁾ ⁽¹¹⁾
rA1	-99	rA2	%r.H./bar ⁽⁹⁾ ⁽¹⁵⁾		minimum value you can assign to the first working setpoint
rA2	rA1	999	%r.H./bar ⁽⁹⁾ ⁽¹⁵⁾		maximum value you can assign to the first working setpoint
rA3	0	1	—	0	direct or reverse action (0 = direct action)
rA4	0	1	—	0	kind of hysteresis (0 = asymmetrical, 1 = symmetrical)
rA5	0	1	—	0	first working setpoint modification lock-out (1 = YES)
rA6	-99	rA7	%r.H./bar ⁽⁹⁾	0.0	lower process variable value the instrument freezes the display (it is important if /9 ≠ 0); look at /r as well
rA7	rA6	999	%r.H./bar ⁽⁹⁾	100	upper process variable value the instrument freezes the display (it is important if /9 ≠ 0); look at /r as well

LABEL	MIN.	MAX.	U.M.	DEF.	SECOND REGULATOR
rb0	-99	99.9	%r.H./bar ⁽⁹⁾	-0.2	hysteresis (differential, it is relative to the second working setpoint); look at rb4 as well ⁽⁹⁾ ⁽¹²⁾
rb1	-99	rb2	%r.H./bar ⁽⁹⁾ ⁽¹⁵⁾		minimum value you can assign to the second working setpoint ⁽⁹⁾
rb2	rb1	999	%r.H./bar ⁽⁹⁾ ⁽¹⁵⁾		maximum value you can assign to the second working setpoint ⁽⁹⁾
rb3	0	1	—	1	direct or reverse action (0 = direct action) ⁽⁹⁾
rb4	0	1	—	0	kind of hysteresis (0 = asymmetrical, 1 = symmetrical) ⁽⁹⁾
rb5	0	1	—	0	second working setpoint modification lock-out (1 = YES) ⁽⁹⁾