

EV3244

Controllers for refrigerated cabinets, counters and islands, with energy-saving strategies and compatible with the EVconnect APP and the EPoCA system




ENGLISH

- Controllers for normal and low temperature units with automatic defrost mode according to the setpoint value.
- Power supply 115... 230 VAC.
- Cabinet probe and evaporator probe (PTC/NTC).
- Door switch input.
- Compressor relay 16 A res. @ 250 VAC.
- Alarm buzzer.
- TTL MODBUS slave port for EVconnect app, EPoCA remote monitoring system or for BMS
- Cooling or heating operation.

1 MEASUREMENTS AND INSTALLATION

Measurements in mm (inches). To be fitted to a panel, snap-in brackets provided.

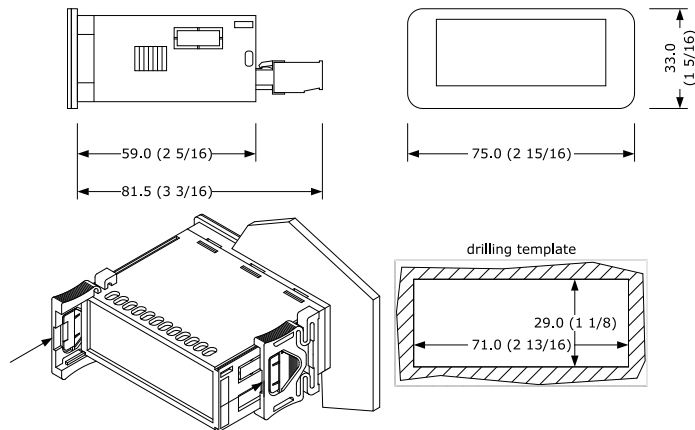


INSTALLATION PRECAUTIONS

- The thickness of the panel must be between 0.8 and 2.0 mm (1/32 and 1/16 in)
- Ensure that the working conditions are within the limits stated in the **TECHNICAL SPECIFICATIONS** section.
- Do not install the device close to heat sources, equipment with a strong magnetic field, in places subject to direct sunlight, rain, damp, excessive dust, mechanical vibrations or shocks.
- In compliance with safety regulations, the device must be installed properly to ensure adequate protection from contact with electrical parts. All protective parts must be fixed in such a way as to need the aid of a tool to remove them.

2 ELECTRICAL CONNECTION

- N.B.
- Use cables of an adequate section for the current running through them.
- To reduce any electromagnetic interference connect the power cables as far away as possible from the signal cables.

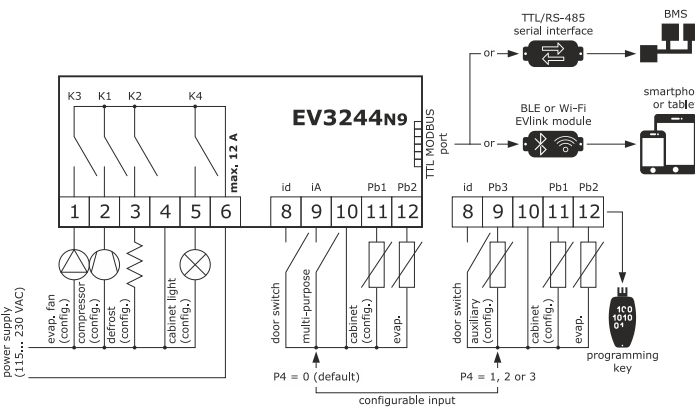

PRECAUTIONS FOR ELECTRICAL CONNECTION

- If using an electrical or pneumatic screwdriver, adjust the tightening torque.
- If the device has been moved from a cold to a warm place, the humidity may have caused condensation to form inside. Wait about an hour before switching on the power.
- Make sure that the supply voltage, electrical frequency and power are within the set limits. See the section **TECHNICAL SPECIFICATIONS**.
- Disconnect the power supply before doing any type of maintenance.
- Do not use the device as safety device.
- For repairs and for further information, contact the EVCO sales network.

3 FIRST-TIME

1. Install following the instructions given in the section **MEASUREMENTS AND INSTALLATION**.
2. Power up the device as shown in the section **ELECTRICAL CONNECTION** and an internal test will be run. The test normally takes a few seconds, when it is finished the display will switch off.
3. Configure the device as shown in the section **Setting configuration parameters**.


Recommended configuration parameters for first-time use.

PAR.	DEF.	PARAMETER	MIN... MAX.
SP	0.0	setpoint	r1... r2
P0	1	probe type	0 = PTC 1 = NTC
P2	0	temperature unit of measurement	0 = °C 1 = °F
d1	0	defrost type	0 = electric 1 = hot gas 2 = compressor stopped

Then check that the remaining settings are appropriate; see the section **CONFIGURATION PARAMETERS**.

4. Disconnect the device from the mains.
5. Make the electrical connection as shown in the section **ELECTRICAL CONNECTION** without powering up the device.
6. For the connection in an RS-485 network connect the interface EVIF22TSX or EVIF23TSX, to activate real time functions connect the module EVIF25TBX, to use the device with the APP EVconnect connect the interface EVIF25TBX. To use the device with the EPoCA remote monitoring system, connect the EVIF25TWX module; see the relevant instruction sheets. **If EVIF22TSX or EVIF23TSX is used, set parameter BLE to 0.**
7. Power up the device.

4 USER INTERFACE AND MAIN FUNCTIONS

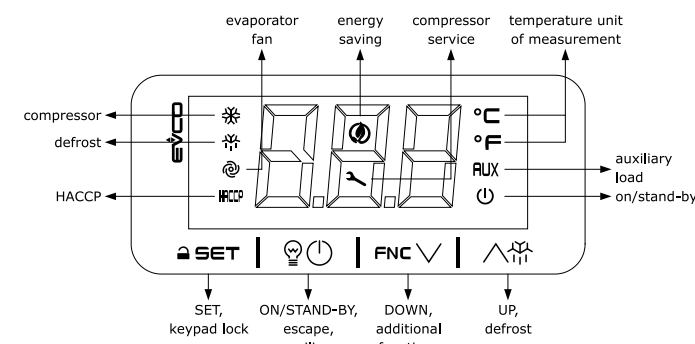

4.1 Switching the device on/off

1. If POF = 1, touch the ON/STAND-BY key for 4 s.

If the device is switched on, the display will show the P5 value ("cabinet temperature" default); if the display shows an alarm code, see the section **ALARMS**.

LED	ON	OFF	FLASHING
	compressor on	compressor off	- compressor protection active - setpoint setting active
	defrost or pre-dripping active	-	- defrost delay active - dripping active
	evaporator fan on	evaporator fan off	- evaporator fan stop active - low humidity operation active
HACCP	saved HACCP alarm in EVlink	-	-
	energy saving active	-	-
	request for compressor service	-	- settings active - access to additional functions active - operation with EVconnect or EPoCA active
°C/°F	view temperature	-	overcooling or overheating active
AUX	auxiliary load on	auxiliary load off	- auxiliary load on by digital input - auxiliary load delay active - demisting on (slow flashing)
	device off	device on	device on/off active

If Loc = 1 (default) and 30 s have elapsed without the keys being pressed, the display will show the "Loc" label and the keypad will lock automatically.

4.2 Unlock keypad

Touch a key for 1 s: the display will show the label "UnL".

4.3 Set the setpoint

Check that the keypad is not locked.

1. Touch the SET key.
2. Touch the UP or DOWN key within 15 s to set the value within the limits r1 and r2 (default "-50... 50").
3. Touch the SET key (or do not operate for 15 s).

4.4 Activate manual defrost

Check that the keypad is not locked and that overcooling is not active.

1. Touch the UP key for 2 s.

If P3 = 1 (default), defrost is activated provided that the evaporator temperature is lower than the d2 threshold.

4.5 Cabinet light on/off (if uc1... uc4 = 3, default)

1. Touch the ON/STAND-BY key.

If uc1... uc4 = 5 and the keypad is not locked, the **button-operated load** switches on/off.

4.6 Switching the demisting on/off (if uc1... uc4 = 4)

1. Touch the UP key.

The demisting is switched on for the u6 duration. If u6 = 0 the demisting is switched on/off manually.

4.7 Silence buzzer

Touch a key.

If uc1... uc4 = 6 and u4 = 1, the alarm output switches off.

5 ADDITIONAL FUNCTIONS

5.1 Activate/deactivate overcooling, overheating and manual energy saving

Check that the keypad is not locked.

1. Touch the DOWN key.

FUNCTION	CONDITION	CONSEQUENCE
overcooling	r5 = 0, r8 = 1 and defrost not active	the setpoint becomes "setpoint - r6", for the r7 duration
overheating	r5 and r8 = 1	the setpoint becomes "setpoint + r6", for the r7 duration
energy saving	r5 = 0 and r8 = 2	the setpoint becomes "setpoint + r4", at maximum for HE2 duration

5.2 Activating the high/low humidity operation (if F0 and F0b = 2)

Check that the keypad is not locked.

1. Touch the DOWN key for 4 s.

LAB.	DESCRIPTION
rH_	low humidity operation (evaporator fan according to F15 and F16 if compressor off, on if compressor on)
rH_	high humidity operation (evaporator fan on)

2. Touch the SET key.
3. Touch the UP or DOWN key to set "149" (when label "rCH" is selected).
4. Touch the SET key.
5. Touch the ON/STAND-BY key (or do not operate for 60 s) to exit the procedure.

5.3 View/delete compressor functioning hours

Check that the keypad is not locked.

1. Touch the DOWN key for 4 s.
2. Touch the UP or DOWN key within 15 s to select a label.

LAB.	DESCRIPTION
CH	view compressor functioning hours (hundreds)
rCH	delete compressor functioning hours

3. Touch the SET key.
4. Touch the UP or DOWN key to set "149" (when label "rCH" is selected).

5. Touch the SET key.
6. Touch the ON/STAND-BY key (or do not operate for 60 s) to exit the procedure.

5.4 View the temperature detected by the probes

Check that the keypad is not locked.

1. Touch the DOWN key for 4 s.
2. Touch the UP or DOWN key within 15 s to select a label.

LAB.	DESCRIPTION
Pb1	cabinet temperature (if P4 = 0, 1 or 2) inlet air temperature (if P4 = 3)
Pb2	evaporator temperature (if P4 = 1 or 2) touch: the UP key to view the optimal evaporation temperature calculated the DOWN key to view the minimum evaporator temperature detected
Pb3	auxiliary temperature (if P4 = 1, 2 or 3)
Pb4	calculated product temperature (CPT; if P4 = 3)

3. Touch the SET key.
4. Touch the ON/STAND-BY key (or do not operate for 60 s) to exit the procedure.

6 SETTINGS

6.1 Setting configuration parameters

1. Touch the SET key for 4 s: the display will show the label "PA".
2. Touch the SET key.
3. Touch the UP or DOWN key within 15 s to set the PAS value (default "-19").
4. Touch the SET key (or do not operate for 15 s): the display will show the label "SP".
5. Touch the UP or DOWN key to select a parameter.
6. Touch the SET key.
7. Touch the UP or DOWN key within 15 s to set the value.
8. Touch the SET key (or do not operate for 15 s).
9. Touch the SET key for 4 s (or do not operate for 60 s) to exit the procedure.

6.2 Set the date, time and day of the week (available if EVIF23TSX, EVIF25TWX or interface EVIF25TBX is connected)

- N.B.
- Do not disconnect the device from the mains within two minutes since the setting of the time and day of the week.
- If the device communicates with the EVconnect app, the date, time and day of the week will be automatically set by the smartphone or tablet.

Check that the keypad is not locked.

1. Touch the DOWN key for 4 s.
2. Touch the UP or DOWN key within 15 s to select the label "rtc".
3. Touch the SET key: the display will show the label "yy" followed by the last two figures of the year.
4. Touch the UP or DOWN key within 15 s to set the year.

5. Repeat actions 3. and 4. to set the next labels.

LAB.	DESCRIPTION OF THE NUMBERS FOLLOWING THE LABEL
n	month (01... 12)
d	day (01... 31)
h	time (00... 23)
n	minute (00... 59)

6. Touch the SET key: the display will show the label for the day of the week.
7. Touch the UP or DOWN key within 15 s to set the day of the week.

LAB.	DESCRIPTION
Mon	Monday
tuE	Tuesday
UEd	Wednesday
thu	Thursday
Fri	Friday
Sat	Saturday
Sun	Sunday

8. Touch the SET key: the device will exit the procedure.
9. Touch the ON/STAND-BY key to exit the procedure beforehand.

7 CONFIGURATION PARAMETERS

N.	PAR.	DEF.	SETPOINT	MIN... MAX.
1	SP	0.0	setpoint	r1... r2
N.	PAR.	DEF.	ANALOGUE INPUTS	MIN... MAX.
2	CA1	0.0	cabinet probe offset	-25... 25 °C/°F if P4 = 3, air in probe offset
3	CA2	0.0	evaporator probe offset	-25... 25 °C/°F
4	CA3	0.0	auxiliary probe offset	-25... 25 °C/°F
5	P0	1	probe type	0 = PTC 1 = NTC
6	P1	1	enable °C decimal point	0 = no 1 = yes
7	P2	0	temperature unit of measurement	0 = °C 1 = °F
8	P3	1	evaporator probe function	0 = disabled 1 = defrost + fan 2 = fan
9	P4	0	configurable input function	0 = digital input 1 = condenser probe 2 = critical temperature probe 3 = air out probe if P4 = 3, regulation temperature = product temperature (CPT)
10	P5	0	value displayed	0 = regulation temperature 1 = setpoint 2 = evaporator temperature 3 = auxiliary temperature 4 = air in temperature
11	P7	5	air in weight for calculated product temperature (CPT)	0... 10 % x 10 CPT = {[(P7 x (air in))] + [(100 - P7) x (air out)] : 100}
12	P8	5	display refresh time	0... 250 s : 10
N.	PAR.	DEF.	REGULATION	MIN... MAX.
13	r0	2.0	setpoint differential	1... 15 °C/°F
14	r1	-50	minimum setpoint	-99 °C/°F... r2
15	r2	50.0	maximum setpoint	r1... 199 °C/°F
16	r4	0.0	setpoint offset in energy saving	0... 99 °C/°F
17	r5	0	cooling or heating operation	0 = cooling 1 = heating

