



- EN ENGLISH**
- back-panel or panel mounting (according to the model)
 - 24 VAC/12... 30 VDC power supply not insulated
 - 5 or 7 in colour touch-screen TFT graphic display (according to the model)
 - clock
 - alarm buzzer
 - 2 RS-485 MODBUS ports
 - CAN port
 - 1 MB program memory
 - **device for indoor applications.**



Purchasing codes	Series	Display size	Installation mode
EPCMOOX4	EPColor M	5 in	back-panel mounted
EPCMO1X4	EPColor M	5 in	panel mounted
EPCLOOX4	EPColor L	7 in	back-panel mounted

For further information please consult the hardware manual.

1 MEASUREMENTS AND INSTALLATION | Measurements in mm (in)

1.1 Measurements and installation EPColor M


1.1.1 Models for back-panel mounting

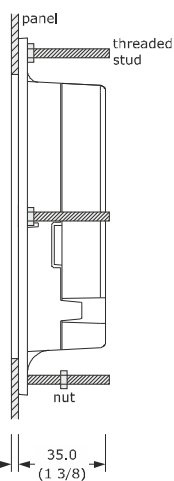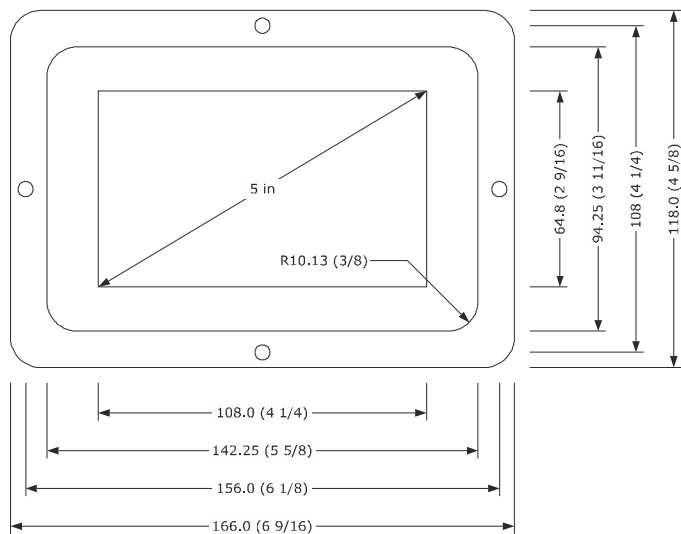

Back-panel mounting, with threaded studs.


1.1.2 Models for panel mounting

- N.B.**
- the thickness of a metal panel must be between 0.8 and 1.5 mm (1/32 and 1/16 in), while that for a plastic panel must be between 0.8 and 3.4 mm (1/32 and 1/8 in)
 - the measurements of drilling template must be 130 x 88.4 mm (5 1/8 x 3 1/2 in), with rounded corners R 3.0 mm (1/8 in).

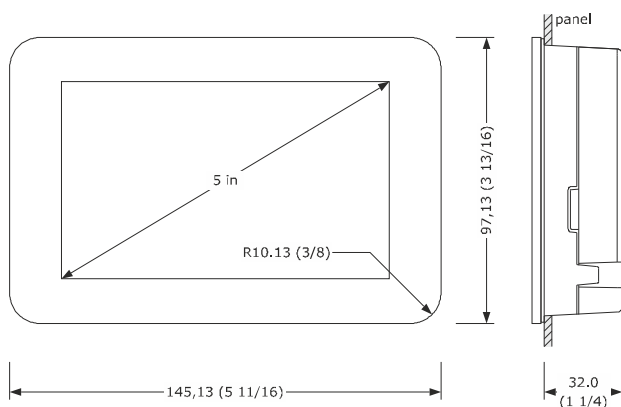

To be fitted to a panel, with elastic holding flaps.

1.2 Measurements and installation EPColor L

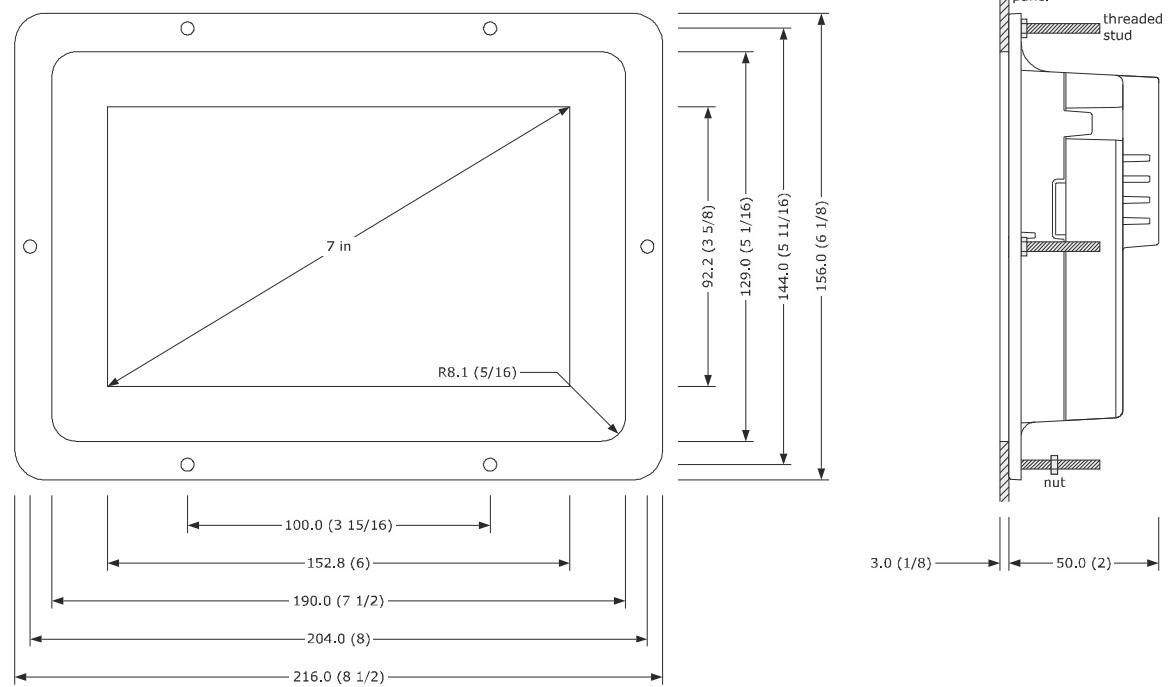

Back-panel mounting, with threaded studs.

INSTALLATION PRECAUTIONS


- Ensure that the working conditions are within the limits stated in the *TECHNICAL SPECIFICATIONS* section
- Do not install the device close to heat sources, equipment with a strong magnetic field, in places subject to direct sunlight, rain, damp, excessive dust, mechanical vibrations or shocks
- In compliance with safety regulations, the device must be installed properly to ensure adequate protection from contact with electrical parts. All protective parts must be fixed in such a way as to need the aid of a tool to remove them.

2 ELECTRICAL CONNECTION

- N.B.**
- Use cables of an adequate section for the current running through them
 - To reduce any electromagnetic interference connect the power cables as far away as possible from the signal cables and connect to a CAN network and RS-485 MODBUS network by using a twisted pair.
 - do not supply another device with the same transformer
 - for the CAN of EPColor M port use a ferrite (for example *Essentra RKCF-08-A5*) to which the conductors of the shielded cable must be wound with two coils.

2.1 Electrical connection EPColor M

2.1.1 Connectors and parts

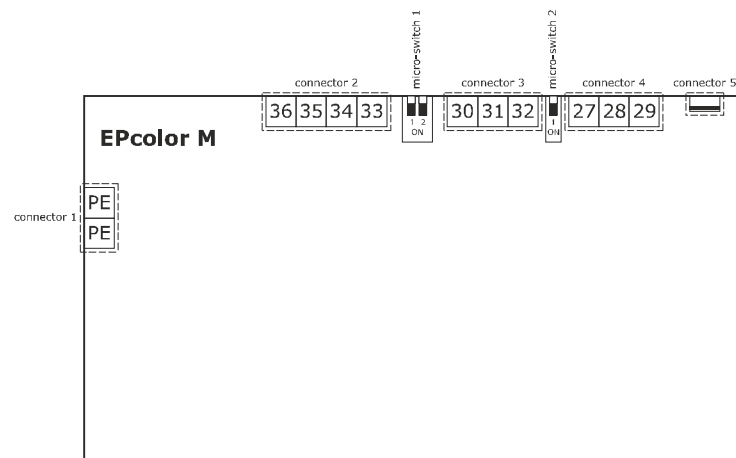

Connector 1

N.	DESCRIPTION
PE	grounding equipment
PE	grounding equipment

Connector 2

N.	DESCRIPTION
36	GND reference device power supply and RS-485 MODBUS master port
35	RS-485 MODBUS master port signal -
34	RS-485 MODBUS master port signal +
33	device power supply (24 VAC/12... 30 VDC)

Connector 3

N.	DESCRIPTION
30	GND reference RS-485 MODBUS slave port
31	RS-485 MODBUS slave port signal -
32	RS-485 MODBUS slave port signal +

Connector 4

N.	DESCRIZIONE
27	GND reference CAN port
28	CAN port signal -
29	CAN port signal +

Connector 5: USB port, for programming the device.

- Micro-switch 1:**
- to insert the RS-485 MODBUS master port termination resistor.
 - to insert the RS-485 MODBUS slave port termination resistor.


Micro-switch 2, to insert the CAN port termination resistor.

2.1.2 Insertion of the RS-485 MODBUS ports and CAN port termination resistor

To insert the RS-485 MODBUS master port termination resistor, place dip 1 of micro-switch 1 in position ON.
To insert the RS-485 MODBUS slave port termination resistor, place dip 2 micro-switch 1 in position ON.
To insert the CAN port termination resistor, place micro-switch 2 in position ON.

2.2 Electrical connection EPcolor L

2.2.1 Connectors and parts

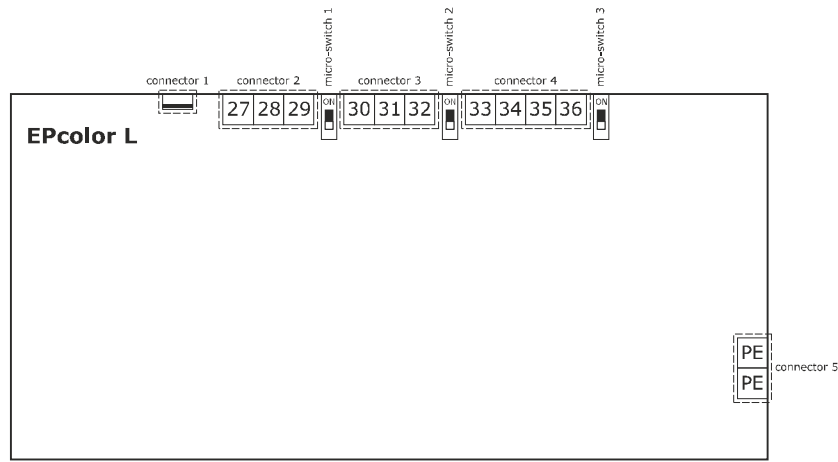

Connector 1: USB port, for programming the device.

Connector 2

N.	DESCRIZIONE
27	GND reference CAN port
28	CAN port signal -
29	CAN port signal +

Connector 3

N.	DESCRIPTION
30	GND reference RS-485 MODBUS slave port
31	RS-485 MODBUS slave port signal -
32	RS-485 MODBUS slave port signal +

Connector 4

N.	DESCRIPTION
33	GND reference device power supply and RS-485 MODBUS master port
34	RS-485 MODBUS master port signal -
35	RS-485 MODBUS master port signal +
36	device power supply (24 VAC/12... 30 VDC)

Connector 5

N.	DESCRIPTION
PE	grounding equipment
PE	grounding equipment

Micro-switch 1: to insert the CAN port termination resistor.

Micro-switch 2: to insert the RS-485 MODBUS slave port termination resistor.

Micro-switch 3: to insert the RS-485 MODBUS master port termination resistor.

2.2.2 Insertion of the RS-485 MODBUS port and CAN port termination resistor

To insert the CAN port termination resistor, place micro-switch 1 in position ON.

To insert the RS-485 MODBUS slave port termination resistor, place micro-switch 2 in position ON.

To insert the RS-485 MODBUS master port termination resistor, place micro-switch 3 in position ON.

PRECAUTIONS FOR ELECTRICAL CONNECTION

- If using an electrical or pneumatic screwdriver, adjust the tightening torque
- If the device has been moved from a cold to a warm place, the humidity may have caused condensation to form inside. Wait about an hour before switching on the power
- Make sure that the supply voltage, electrical frequency and power are within the set limits. See the section *TECHNICAL SPECIFICATIONS*
- Disconnect the power supply before doing any type of maintenance
- Do not use the device as safety device
- For repairs and for further information, contact the EVCO sales network; possible returns without label data will not be accepted.

3 TECHNICAL SPECIFICATIONS

Purpose of the control device	Function controller	
Construction of the control device	Built-in electronic device	
Container	Black, self-extinguishing	
Category of heat and fire resistance	D	
Measurements	EPcolor M models for back-panel mounting	166.0 x 118.0 x 35.0 mm (6 9/16 x 4 5/8 x 1 3/8 in)
	EPcolor M models for panel mounting	145.13 x 97.13 x 32.0 mm (5 11/16 x 3 13/16 x 1 1/4 in)
	EPcolor L	216.0 x 156.0 x 50.0 mm (8 1/2 x 6 1/8 x 2 in)
Mounting methods for the control device	According to the model, back-panel mounting (with threaded studs) or panel mounting (with elastic holding flaps)	
Connection method	Removable screw terminal blocks for wires up to 1 mm ²	
Maximum permitted length for connection cables		
Power supply: 10 m (32.8 ft)	RS-485 MODBUS port: 1,000 m (3,280 ft)	
CAN port:		
- 1,000 m (3,280 ft) with baud rate 20.000 baud		
- 500 m (1,640 ft) with baud rate 50.000 baud		
- 250 m (820 ft) with baud rate 125.000 baud		
- 50 m (164 ft) with baud rate 500.000 baud		
Over 10 m (32.8 ft) use a shielded cable		
Operating temperature	From 0 to 55 °C (from 32 to 131 °F)	
Storage temperature	From -20 to 70 °C (from -4 to 158 °F)	
Operating humidity	Relative humidity without condensate from 5 to 95%	
Pollution status of the control device	2	
Compliance		
RoHS 2011/65/EC	WEEE 2012/19/EU	
REACH (EC) Regulation N. 1907/2006	EMC 2014/30/UE	RED 2014/53/UE
Power supply		
24 VAC (±15%), 50/60 Hz (±3 Hz), max. 6.5 VA not insulated or 12... 30 VDC, max. 3 W not insulated in EPcolor M	24 VAC (±15%), 50/60 Hz (±3 Hz), max. 10 VA not insulated or 12... 30 VDC, max. 4.6 W not insulated in EPcolor L	
Earthing methods for the control device	None	
Rated impulse-withstand voltage	I	
Over-voltage category	330 V	
Software class and structure	A	
Clock	Incorporated secondary lithium battery	
Clock drift	≤ 55 s/month at 25 °C (77 °F)	
Clock battery autonomy in the absence of a power supply	6 months	
Clock battery charging time	24 h (the battery is charged by the power supply of the device)	
Displays	EPcolor M models	5 in colour touch-screen TFT graphic display
	EPcolor L models	7 in colour touch-screen TFT graphic display
Alarm buzzer	Built-in	
Program memory	1 MB	
Communications ports		
1 RS-485 MODBUS master port	1 RS-485 MODBUS slave port	
1 CAN port	1 USB port	

N.B. The device must be disposed of according to local regulations governing the collection of electrical and electronic waste.

This document and the solutions contained therein are the intellectual property of EVCO and thus protected by the Italian Intellectual Property Rights Code (CPI). EVCO imposes an absolute ban on the full or partial reproduction and disclosure of the content other than with the express approval of EVCO. The customer (manufacturer, installer or end-user) assumes all responsibility for the configuration of the device.

EVCO accepts no liability for any possible errors in this document and reserves the right to make any changes, at any time without prejudice to the essential functional and safety features of the equipment.