



PROGRAMMABLE DIGITAL TIMER with "count continuation and count holding" functions and with two outputs

EC 7-102

GENERAL CHARACTERISTICS

- * Frontal size: 72 x 72 mm.
- * Power supply: 230 Vac (standard).
- * Signalling buzzer included.
- * Custom configuration through keyboard or Personal Computer.
- * Four digits display height 10 mm.
- * "Count continuation" function.
- * "Count holding" function.

- * Possibility of programming: time base for each status, inputs and outputs functionality, modality of "Start" and "Stop" inputs enabling, count mode (up or down), length of each status.
- * Two remote inputs for to start and to stop a cycle of counting.
- * Two 8 A at 250 Vac relay outputs.
- EC 7-102 is a programmable digital timer with two outputs designed to meet the applications connected to time intervals.

A complete cycle of counting has five status of programmable length and connected in cascade since, the end of one, automatically determines the passage to the following one; besides that, the instrument offers the possibility of programming the time base for each status, the modality of "Start" and "Stop" inputs enabling, the count mode (up or down) and the possibility to display the count during each status.

The "count continuation" function permits to continue the count when a cycle of counting ends and the "count holding" function permits to interrupt and to take again a count on run.

The presence on mass production of two remote inputs for to start and to stop a cycle of counting, makes this device particularly indicated to the use in TTL logics, increasing its field of application.

The two 6 (3) A at 250 Vac relay outputs with change-over contact (output 1) and N.O. contact (output 2) are supplied in standard version and their functionality is widely configurable: as option it is possible to request outputs with low voltage signal, suitable to drive the S.S.R. modules (solid state relay).

The signalling buzzer and the flashing indications have been designed in order to catch user's attention at the end of a cycle of counting.

FUNCTIONING

A complete cycle of counting has five status connected in cascade since, the end of one, automatically determines the passage to the following one.

EVERY CONTROI

"Status 0" (dedicated parameters t 1, t 4, t 7, t8, t12, t21, t25):

At any reset or after a "Stop" input the instrument automatically moves to the "Status 0" (the modality that enables the "Stop" input can be established with the parameter "t 5").

For all the length of this status on the display appear:

- the time to be counted during the "Status 2" if the parameter "t 6" has value 0

- the indication "00:00" if the parameter "t 6" has value 1

the lighting indicators located in the middle of the display are lighted, the outputs are deactivated.

A "Start" input during this status forces the instrument to the "Status 1" (the modality that enables the "Start" input can be established with the parameter "t 4").

"Status 1" (dedicated parameters t 0, t 2, t 5, t 6, t 8, t11, t12, t21, t25, t31):

The "Status 1" permits to delay the activation of the following status.

During this status the instrument counts the time established with the parameter "t11", according to the time base established with the parameter "t 0".

For all the length of this status on the display appear:

- the time to be counted in the following status if the parameters "t $\mathbf{6}$ " and "t31" have value 0
- the indication "00:00" if the parameter "t 6" has value 1 and the parameter "t31" has value 0
- the countdown of the time to be counted in this status if the parameter "t 6" has value 0 and the parameter "t31" has value 1
- the count up of the time to be counted in this status if the parameters "t 6" and "t31" have value 1

the lighting indicators located in the middle of the display alternately flash, the outputs are not activated.

At the end of the established time the "Status 1" ends and the device automatically moves to the "Status 2".

NOTES: - one "Stop" input during this status forces the instrument to the "Status 0", on the display remains the indication showed during the "Status 0".

"Status 2" (dedicated parameters t 2, t 5, t 6, t 8, t10, t12, t21, t25, t32):

During this status the instrument counts the time established with the keys located on the frontal panel, according to the time base established with the parameter "t10".

To set the time to be counted during the "Status 2" push and release the key (set): the most important side of the display flashes; operate with the keys (a) or (b) within 4 seconds since the first pressure on key (set) to modify its value.

To set the value of the least important side of the display push and release the key (set) during the flashing of the most important side of the display: the least important side of the display flashes; operate with the keys (set) or (set) within 4 seconds since the second pressure on key (set) to modify its value.

To leave the procedure of setting of the time to be counted during the "Status 2" wait 4 seconds without operate on the keys (time-out exit) or push and release for a third time the key (set).

For all the length of this status on the display appear:

- the time to be counted in this status if the parameters "t 6" and "t32" have value 0
- the indication "00:00" if the parameter "t $\mathbf{6}$ " has value 1 and the parameter "t32" has value 0
- the countdown of the time to be counted in this status if the parameter "t 6" has value 0 and the parameter "t32" has value 1
- the count up of the time to be counted in this status if the parameters "t 6" and "t32" have value 1

the lighting indicators located in the middle of the display flash at the same time, the output 1 is activated.

At the end of the established time the "Status 2" ends and the device automatically moves to the "Status 3".

- NOTES: if the parameter "t12" has value 1, the output 1 always is activated except during this status
 - if the parameter "t25" has value 2, the output 1 gets activated/deactivated with the same modality of the output 2, respecting the parameter "t12" only

- one "Stop" input during this status forces the instrument to the "Status 0", on the display remains the indication showed during the "Status 0".

"Status 3" (dedicated parameters t 0, t 2, t 5, t 6, t 8, t12, t20, t21, t25, t33):

The "Status 3" permits to delay the activation of the following status.

During this status the instrument counts the time established with the parameter "t20", according to the time base established with the parameter "t 0".

For all the length of this status on the display appear:

- the indication "00:00" if the parameters "t $\mathbf{6}$ " and "t33" have value 0
- the time counted in the preceding status if the parameter "t 6" has value 1 and the parameter "t33" has value 0
- the countdown of the time to be counted in this status if the parameter "t 6" has value 0 and the parameter "t33" has value 1

EVERY CONTROI

- the count up of the time to be counted in this status if the parameters "t 6" and "t33" have value 1

the lighting indicators located in the middle of the display alternately flash, the outputs are not activated.

At the end of the established time the "Status 3" ends and the device automatically moves to the "Status 4".

NOTES: - one "Stop" input during this status forces the instrument to the "Status 0", on the display remains the indication showed during the "Status 0".

"Status 4" (dedicated parameters t 2, t 3, t 5, t 6, t 7, t 8, t12, t21, t22, t23, t24, t25, t34):

During this status the instrument counts the time established with the parameter "t24", according to the time base established with the parameter "t23".

For all the length of this status the signalling buzzer is activated according to the modality established with the parameter "t 3", on the display appear:

- the indication "00:00" if the parameters "t 6" and "t34" have value 0
- the time counted during the "Status 2" if the parameter "t 6" has value 1 and the parameter "t34" has value 0
- the countdown of the time to be counted in this status if the parameter "t 6" has value 0, the parameter "t34" has value 1 and the parameter "t22" has value 2
- the count up of the time to be counted in this status if the parameters "t 6" and "t33" have value 1 and the parameter "t22" has value 2

the lighting indicators located in the middle of the display flash at the same time, the output 2 is activated.

At the end of this status:

- if the parameter "t 7" has value 0, the instrument automatically moves to the "Status 0", on the display remains the indication showed during the "Status 0" (the modality that ends the "Status 4" can be established with the parameter "t22")
- if the parameter "t 7" has value 1 and the parameter "t22" has value 2, the instrument automatically moves to the "Status 1" and it continues the count.

NOTES: - if the parameter "t21" has value 1, the output 2 always is activated except during this status

- if the parameter "t25" has value 1, the output 2 gets activated/deactivated with the same modality of the output 1, respecting the parameter "t21" only
- one "Stop" input during this status forces the instrument to the "Status 0", on the display remains the indication showed during the "Status 0".

"Count holding" function (dedicated parameter t 8):

"Count holding" function was studied to permit to interrupt and to take again a count on run.

Function depends from the parameter "t 8" as indicated:


- if the parameter "t 8" has value 0 the function is inactive

- if the parameter "t 8" has value 1 the function can be activated/deactivated through a "Start" input; for all the length of the "count holding" on the display flashes the indication showed at the moment of the function activation
- if the parameter "t 8" has value 2 the function is active during the activation of the "E 1" remote input only.

INSTALLATION

For a proper installation, take note of the attached indications; be sure that the conditions of use (environment temperature, humidity, power supply voltage) are inside the indicated limits; do not overload the relay outputs keep inside the indicated limits.

WARNING: the instrument is not protected from overloads; so it is necessary to give the outputs the suitable protections. The power supply is protect with an internal fuse

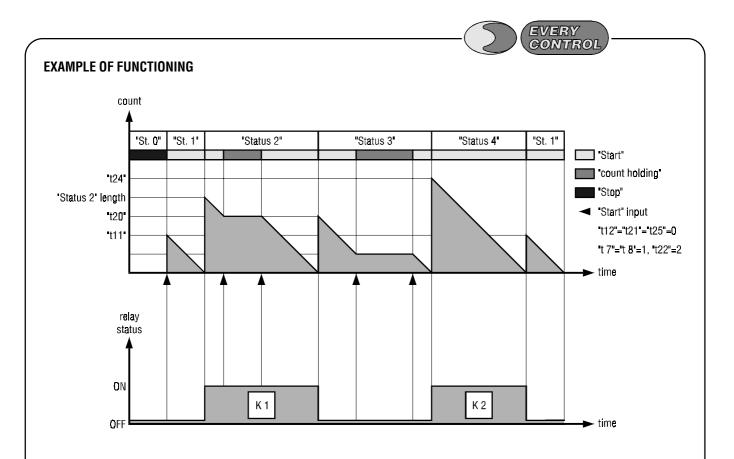

ALARMS

"E:2" flashing on the display and buzzer beeping intermittent (corrupted memory data alarm) indicate the failure of the memorised configuration data: try to switch the power supply off and then switch it on; if to the restart the alarm condition does not disappear it is necessary to change the instrument (all the outputs are deactivated).

PARAMETERS CONFIGURATION

The configuration parameters programming can be done during the status "Status 0" only, if there is not a corrupted memory data alarm.

Programming procedure for the parameters "t11", "t20" and "t24"

 A) Keep pushed B) Push C) Push and release operate with D) Push and release for a second time 		and or or		at the same time for 4 seconds at least: on the display appear "t 0". to select the parameter to modify. the most important side of the display flashes; within 4 seconds since the first pressure on (set) to modify its value. during the flashing of the most important side of the display: since now the least important side of the display flashes;
operate with E) After the modify push and release for Programming proceedure for all of			set	within 4 seconds since the second pressure on (set) to modify its value. or wait 4 seconds without operate on the keys (time-out exit).
Programming procedure for all of Follow the procedure described in A and F) Push and release G) Push	-	or	set	to display the actual value of the selected parameter. within 4 seconds since the pressure on (set) to modify its value.
H) After the modify push and releaseHow to leave the programming p	orocedur		set)	or wait 4 seconds without operate on the keys (time-out exit).
Keep pushed		and	\bigcirc	at the same time for 4 seconds at least or wait 50 seconds without operate on the keys (time-out exit).

CONFIGURATION PARAMETERS

	COD.	PARAMETER	DESCRIPTION	MIN.	MAX.	U.M.	ST.
	t 0	"Status 1" and "Status 3" time base	0=sec.:dec.; 1=min.:sec.; 2=hours:min.	0	2		0
	t1	E 1 switching mode	0=rising (N.C. cont.); 1=falling (N.O. cont.)	0	1		0
	t 2	E 2 switching mode	0=rising (N.C. cont.); 1=falling (N.O. cont.)	0	1		0
	t 3	signalling buzzer functioning during the "Status 4"	0=excluded; 1=continuous; 2=intermittent	0	2		0
	t 4	modality of "Start" input enabling	0=UP or E 1; 1=UP; 2=E 1	0	2		0
	t 5	modality of "Stop" input enabling	0=DOWN or E 1; 1=DOWN; 2=E 1	0	2		0
	t 6	count mode	0=countdown; 1=countup	0	1		0
	t 7	count continuation function	0=NO; 1=YES	0	1		0
(1)	t 8	count holding		0	2		0
	t10	"Status 2" time base	0=sec.:dec.; 1=min.:sec.; 2=hours:min.	0	2		0
	t11	"Stato 1" lenght		see TABLE 1		-	0
	t12	output 1 activated ON or OFF	0=0N; 1=0FF	0	1		0
	t20	"Stato 3" lenght		see TABLE 1			0
	t21	output 2 activated ON or OFF	0=0N; 1=0FF	0	1		0
(2)	t22	end of "Status 4" modality		0	2		0
	t23	"Status 4" time base	0=sec.:dec.; 1=min.:sec.; 2=hours:min.	0	1		0
	t24	"Stato 4" lenght		see TABLE 1		-	0
	t25	outputs configuration		see TABLE 2			0
	t31	count showing during the "Status 1"	0=NO; 1=YES	0	1		0
	t32	count showing during the "Status 2"	0=NO; 1=YES	0	1		0
	t33	count showing during the "Status 3"	0=NO; 1=YES	0	1		0
	t34	count showing during the "Status 4"	0=N0; 1=YES	0	1		0
	L	NETWORK CONNECTION					
	L 1	instrument address		1	15		1
	L 2	instrument group		0	7		0

NOTES

- (1) = see "Count holding" function.
- (2) = the "Status 4" can end according to one of the following modality:
 - for a "Stop" input ("**t22**"=0)
 - for a "Start" or "Stop" input ("t22"=1)
 - for a "Stop" input or at the end of the established time ("t22"=2).


TABLE 1

"Status ..."range of timer settingtime baseresolutiondisplay end of scalesec.:dec.00:1099:90min.:sec.00:0199:59hours:min.00:0199:59

TABLE 2

parameter "t25"	K1	K2	Notes	
	linked to	linked to		
0	output 1	output 2	-	
1	output 1	output 1	K 2=K 1	
2	output 2	output 2	K 1=K 2	

EVERY CONTROL

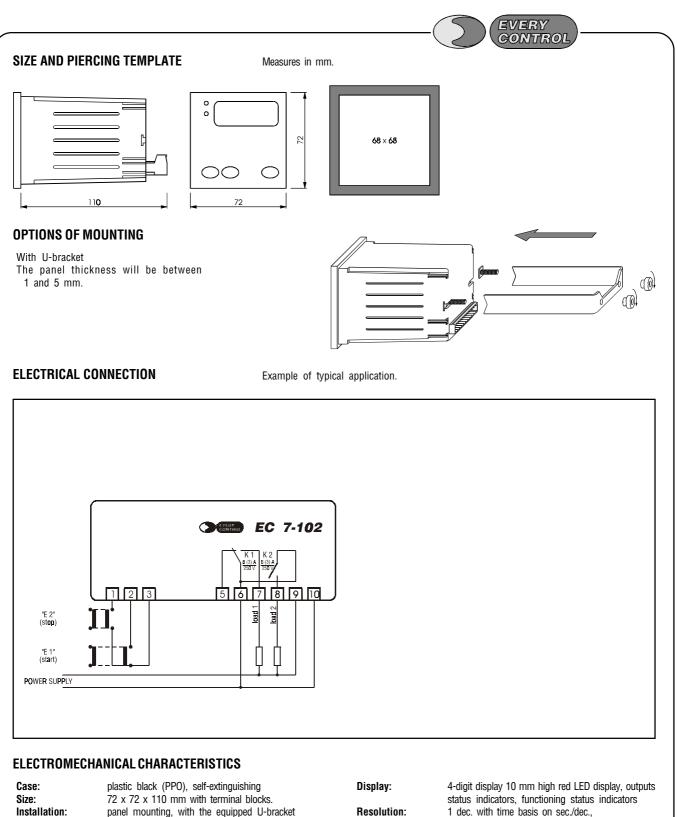

	p		· ····································
Size:	72 x 72 x 110 mm with terminal blocks.		status indicators, functioning status indicators
Installation:	panel mounting, with the equipped U-bracket	Resolution:	1 dec. with time basis on sec./dec.,
ambient			1 sec. with time basis on min./sec.,
temperature:	from 0 to +60 °C.		1 min. with time basis on hours/min.
Humidity:	10 90% of not condensing relative humidity	Alarm buzzer:	incorporated.
Connections:	extractable screw terminal block	Outputs:	1 SPDT 8 A @ 250 Vac output 1 (K 1),
Power supply:	230 Vac or 115 Vac or 24 Vac or 12-24 Vac/dc or		1 SPST 8 A @ 250 Vac output 2 (K 2).
	12 Vac/dc		,
Insulation class:	II.		
Digital inputs:	2 (5 V, 1 mA) for the remote activation of the start and		
•	stop commands configurables for NO or NC contact		
Working range:	from 1 dec. to 99 hours and 59 min.		
Setting range:	from 0 to 99 hours and 59 min.		

2 '01