

# EVK204 Digital controller for ventilated refrigerating units, with HACCP and Energy Saving functions

**ENGLISH**


## 1 PREPARATIONS

### 1.1 Important


Please read these instructions carefully prior to installation and use, and follow all the precautions for installation and electrical connections; keep these instructions with the device for future consultation.

### 1.2 Installazion

For the panel, using the snap-on brackets supplied; the dimensions are given in mm [in].

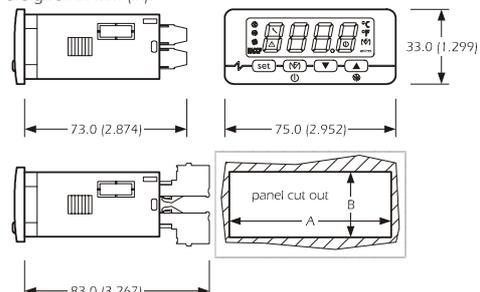

DIMENS.	MIN	TYPICAL	MAX
A	71.0 (2.795)	71.0 (2.795)	71.8 (2.826)
B	29.0 (1.141)	29.0 (1.141)	29.8 (1.173)

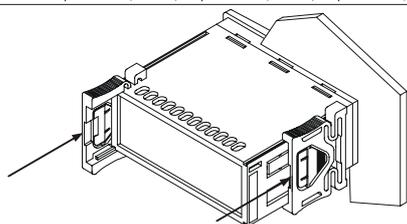


Recommendations for installation:

- the panel thickness must not exceed 8.0 mm (0,314 in)
- ensure that the operating conditions (operating temperature, humidity, etc.) are within the limits indicated in the technical data sheets
- do not install the device near to any sources of heat (heating elements, hot air conduits, etc.), equipment containing powerful magnets (large diffusers, etc.), areas affected by direct sunlight, rain, humidity, excessive dust, mechanical vibration or shock
- in compliance with safety regulations, the device must be installed correctly, and in such a way as to protect against any contact with electrical parts; all safety devices must be fixed so that they cannot be removed without the use of tools.

### 1.3 Electrical connections

With reference to the electrical circuit diagram:

- the service controlled by the fourth output depends on param. P4
- the service controlled by the fourth output depends on param. u1
- port 1 (by request) is the serial port used for communication with the monitoring system (by means of a serial interface, via TTL, using the MODBUS communication protocol) or with the programming key; the port must not be used for both purposes simultaneously
- port 2 (by request) is the port used for comm. with the remote indicator; the indicator displays the quantity assigned by parameter P6.

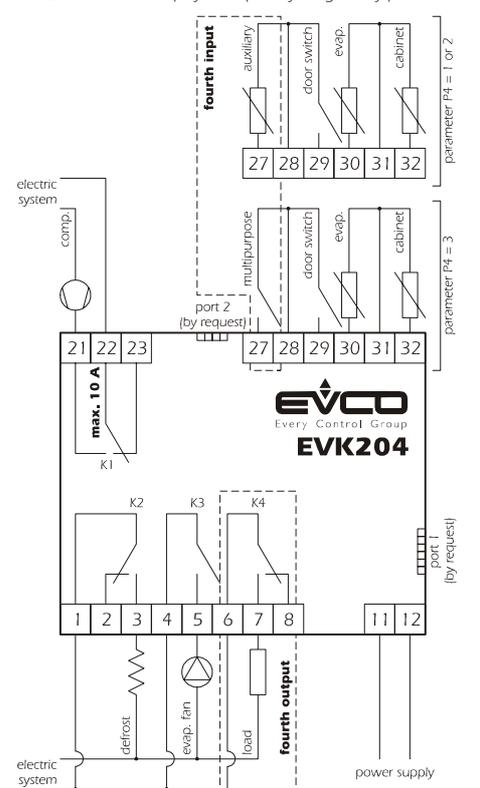

Points to note in relation to electrical connections:

- do not use electric or pneumatic screw-wrenches on the terminal board
- if the device has been moved from a cold to a warm environment, condensation may have formed inside; please wait approx. one hour prior to switching on
- ensure that the voltage, frequency and operational power of the device are compatible with the local power supply
- disconnect the power prior to proceeding with any kind of maintenance operation
- do not use the device as a safety device
- for repairs and any information relating to the device, contact the Evco dealer network.

## 2 USER INTERFACE

### 2.1 Introductory comments

The device has the following operational states:

- "on" (power is connected and the device is on: the regulators may be switched on)
- "stand-by" (power is connected but software sets the device to off: the regulators are switched off; the option of manually switching on/off the cabinet light or the auxiliary output depends on parameter u2).

The term "switching on" is understood to mean switching from the stand-by state to on; the term "switching off" is understood to mean switching from the on state to the stand-by state.

When the device is switched on, the status it was in when the power was interrupted is restored.

### 2.2 Manual switching on/off of the device

- ensure the keyboard is not blocked and that no procedures are running
- press **[M]** for 4 s.

It is also possible to switch the device on/off using the multifunction input.

### 2.3 The display

If the device is switched on, then during normal operation the display will show the quantity assigned by parameter P5:

- if P5 = 0, the display will show the temperature of the cabinet
- if P5 = 1, the display will show the operational setpoint
- if P5 = 2, the display will show the evaporator temperature
- if P5 = 3, the display will show "cabinet temperature - evaporator temperature"
- if P5 = 4, the display will show the temperature detected by the auxiliary probe (only if parameter P4 is set to 1 or 2).

While in stand-by mode the display is switched off.

### 2.4 Displaying the cabinet temperature

- ensure the keyboard is not blocked and that no procedures are running
  - press **[V]** for 2 s: the display will show the first available label
  - press **[▲]** or **[▼]** to select "Pb1"
  - press **[set]**
- To exit the procedure:
- press **[set]** or do not operate the keypad for 60 s
  - press **[▲]** or **[▼]** until the display shows the quantity assigned by parameter P5 or do not operate the keypad for 60 s.

Alternatively:

- press **[M]**

### 2.5 Displaying the evaporator temperature

- ensure the keyboard is not blocked and that no procedures are running
  - press **[V]** for 2 s: the display will show the first available label
  - press **[▲]** or **[▼]** to select "Pb2"
  - press **[set]**
- To exit the procedure:
- press **[set]** or do not operate the keypad for 60 s
  - press **[▲]** or **[▼]** until the display shows the quantity assigned by parameter P5 or do not operate the keypad for 60 s.

Alternatively:

- press **[M]**
- If there is no evaporator probe (parameter P3 = 0), label "Pb2" will not be displayed.

### 2.6 Displaying the temperature detected by the auxiliary probe (only if parameter P4 is set to 1 or 2)

- ensure the keyboard is not blocked and that no procedures are running
  - press **[V]** for 2 s: the display will show the first available label
  - press **[▲]** or **[▼]** to select "Pb3"
  - press **[set]**
- To exit the procedure:
- press **[set]** or do not operate the keypad for 60 s
  - press **[▲]** or **[▼]** until the display shows the quantity assigned by parameter P5 or do not operate the keypad for 60 s.

Alternatively:

- press **[M]**

If the function of the fourth input is not that of the auxiliary probe (parameter P4 = 0 or 3), then label "Pb3" will not be displayed.

### 2.7 Manual activation of defrosting

- ensure the keyboard is not blocked and that no procedures are running

- press **[▲]** for 4 s.

If the function of the evaporator probe is that of the defrosting probe (parameter P3 = 1) and on activation of defrosting the evaporator temperature is above that established by parameter d2, then defrosting will not be activated.

### 2.8 Manual switching on/off of the cabinet light (only if parameter u1 is set to 0)

- ensure no procedures are running

- press **[M]**

It is also possible to switch the cabinet light on/off remotely using the microport and multifunction inputs; see also parameter u2.

### 2.9 Switching on the demister (only if parameter u1 is set to 1)

- ensure the device is switched on and no procedures are running
- press **[M]** for 2 s: the demister heater will be switched on for the period of time established by parameter u6.

Manual switching off of the demister is not permitted.

### 2.10 Manual switching on/off of the auxiliary output (only if parameter u1 is set to 2)

- ensure the keyboard is not blocked and that no procedures are running
- press **[M]**

It is also possible to switch the auxiliary output on/off using the multifunction input.

If the auxiliary output has been switched on manually, then it will be permitted to switch it off the same way (the same principle applies for remote switching on); see also parameter u2.

### 2.11 Blocking/unblocking the keyboard

To block the keyboard:

- ensure no procedures are running
  - press **[set]** and **[V]** for 2 s: the display will show "Loc" for 1 s.
- If the keyboard is blocked, it will not be possible to:

- manually switch the device on/off
- display the cabinet temperature (using the procedure indicated in paragraph 2.4)
- display the evaporator temperature (using the procedure indicated in paragraph 2.5)
- display the temperature detected by the auxiliary probe (using the procedure indicated in paragraph 2.6)
- manually activate defrosting
- manually switch the auxiliary output on/off
- view information pertaining to the HACCP alarms
- delete the HACCP alarm list

change the operational setpoint using the procedure indicated in paragraph 3.1 (the operational setpoint may also be set by means of parameter SP)

- display the total hours of compressor operation
- delete the total hours of compressor operation.

These operations will cause the label "Loc" to be displayed for 1 s.

To unblock the keyboard:

- press **[set]** and **[V]** for 2 s: the display will show "UnL" for 1 s.

### 2.12 Buzzer mute

- ensure no procedures are running
  - press any key (the first key press does not trigger the associated effect).
- If parameter u1 is set to 4 (or the service controlled by the fourth output is the alarm output) and parameter u4 is set to 1, then pressing he key will also deactivate the alarm output.

## 3 SETTINGS

### 3.1 Setting the operational setpoint

- ensure the keyboard is not blocked and that no procedures are running
  - press **[set]** the LED will flash
  - press **[▲]** or **[▼]** within 15 s; also see parameters r1, r2 and r3
  - press **[set]** or do not operate the keypad for 15 s.
- It is also possible to set the operational setpoint by means of parameter SP.

### 3.2 Setting the configuration parameters

To access the procedure:

- ensure no procedures are running
  - press **[▲]** and **[▼]** for 4 s: the display will show "PA"
  - press **[set]**
  - press **[▲]** or **[▼]** within 15 s to set "-19"
  - press **[set]** or do not operate the keypad for 15 s
  - press **[▲]** and **[▼]** for 4 s: the display will show "SP"
- To select a parameter:
- press **[▲]** or **[▼]**
- To select a parameter:
- press **[set]**
  - press **[▲]** or **[▼]** within 15 s
  - press **[set]** or do not operate the keypad for 15 s.
- To exit the procedure:
- press **[▲]** and **[▼]** for 4 s or do not operate the keypad for 60 s.

### Interrupt the device power supply after altering the parameters.

### 3.3 Resetting configuration parameter default values

- ensure no procedures are running
- press **[▲]** and **[▼]** for 4 s: the display will show "PA"
- press **[set]**
- press **[▲]** or **[▼]** within 15 s to set "743"
- press **[set]** or do not operate the keypad for 15 s
- press **[▲]** and **[▼]** for 4 s: the display will show "DEF"

- press **set**
- press **▲** or **▼** within 15 s to set "149"
- press **set** or do not operate the keypad for 15 s: the display will flash "dEF" for 4 s, after which the device will exit the procedure
- interrupt the power to the device.

**Ensure that the parameter default values are appropriate, particularly if the probes are PTC type.**

#### 4 HACCP

##### 4.1 Introductory comments

The device is capable of storing up to 3 HACCP alarms.

The device can furnish the following information:

- the critical value
- the alarm duration (from 1 minute to 99 hours and 59 minutes, partial if the alarm is ongoing).

CODE	ALARM TYPE (AND CRITICAL VALUE)
<b>AL</b>	minimum temperature alarm (the minimum temperature of the cabinet or the minimum temperature detected by the auxiliary probe during an any alarm state of this type)
<b>AH</b>	maximum temperature alarm (the maximum temperature of the cabinet or the maximum temperature detected by the auxiliary probe during an any alarm state of this type)
<b>id</b>	microport input alarm (the maximum temperature of the cabinet during an any alarm state of this type); see also parameter i4

##### Warnings:

- the device records minimum temperature alarms and maximum temperature alarms providing the temperature associated with the alarm is the cabinet temperature (parameters A0 and A3 = 0) or the temperature measured by the auxiliary probe, providing its function is that of display probe (parameter P4 = 1 and parameters A0 = 2 and A3 = 1)
- the instrument updates the information on the alarms on condition that the critical value is more critical than the one the instrument has stored or on condition that the information has already been displayed
- no alarms will be recorded if the device is in stand-by mode.

When the cause of the alarm is resolved, the display returns to normal. The HACCP LED provides information relating to the status of the HACCP alarm memory; please refer to paragraph 6.1.

##### 4.2 Viewing HACCP alarm information

To access the procedure:

- ensure the keyboard is not blocked and that no procedures are running
- press **▼** for 2 s: the display will show the first available label
- press **▲** or **▼** to select "LS"
- press **set** the display will show one of the codes reported in the table in paragraph 4.1.

To select an alarm:

- press **▲** or **▼** (to select "AH" for example).
- To display the information relating to the alarm:
- press **set** the HACCP LED will stop flashing and remain on and the display will show the following information in succession (for example):

INFO	MEANING
<b>8,0</b>	the critical value is 8.0 °C/8 °F
<b>dur</b>	the display is about to show the alarm duration
<b>h01</b>	the alarm lasted for 1 hour (continued ...)
<b>n15</b>	the alarm lasted for 1 hour and 15 minutes
<b>AH</b>	the selected alarm

The display shows each piece of information for 1 s.

To exit the information series:

- press **⏏** the display will show the selected alarm.

To exit the procedure:

- exit the information series
- press **▲** or **▼** until the display shows the quantity assigned by parameter P5 or do not operate the keypad for 60 s.

Alternatively:

- exit the information series

- press **⏏**

If the instrument has stored no alarm, the label "LS" will not be shown.

##### 4.3 Deleting the HACCP alarm list

- ensure the keyboard is not blocked and that no procedures are running
- press **▼** for 2 s: the display will show the first available label
- press **▲** or **▼** to select "rLS"
- press **set**
- press **▲** or **▼** within 15 s to set "149"
- press **set** or do not operate the keypad for 15 s: the display will flash "----" for 4 s and the HACCP LED will be turned off, after which the device will exit the procedure.

If the instrument has stored no alarm, the label "rLS" will not be shown.

#### 5 COMPRESSOR OPERATION TIME COUNTER

##### 5.1 Introductory comments

The device is capable of recording up to 9,999 hours of compressor function, after which the number "9999" flashes.

##### 5.2 Displaying the compressor operation time

- ensure the keyboard is not blocked and that no procedures are running
- press **▼** for 2 s: the display will show the first available label

- press **▲** or **▼** to select "CH"

- press **set**

To exit the procedure:

- press **set** or do not operate the keypad for 60 s
- press **▲** or **▼** until the display shows the quantity assigned by parameter P5 or do not operate the keypad for 60 s.

Alternatively:

- press **⏏**

##### 5.3 Resetting the compressor operation time

- ensure the keyboard is not blocked and that no procedures are running
- press **▼** for 2 s: the display will show the first available label
- press **▲** or **▼** to select "rCH"
- press **set**
- press **▲** or **▼** within 15 s to set "149"
- press **set** or do not operate the keypad for 15 s: the display will flash "----" for 4 s, after which the device will exit the procedure.

#### 6 INDICATORS

##### 6.1 Indicators

LED	MEANING
	compressor LED if on then the compressor is on if flashing: <ul style="list-style-type: none"> <li>the operational setpoint is being changed</li> <li>compressor protection is ongoing (parameters C0, C1, C2 and i7)</li> </ul>
	defrosting LED if on, defrosting ongoing if flashing: <ul style="list-style-type: none"> <li>defrosting has been requested, but compressor protection is ongoing (parameters C0, C1 and C2)</li> <li>drip-draining is ongoing (parameter d7)</li> <li>refrigerant fluid heating is ongoing (parameter dA)</li> </ul>
	Evaporator fan LED if on then the evaporator fan is on if flashing, then evaporator fan stop is ongoing (parameter F3)
<b>HACCP</b>	HACCP LED if on, you will have not shown all the information on the HACCP alarms if flashing, the instrument will have stored at least one new HACCP alarm if off, you will have shown all the information on the HACCP alarms or you will have cancelled the list of the HACCP alarms
	Maintenance LED if on, compressor maintenance will be required (parameter C10)
	alarm LED if on, an alarm state or an error is ongoing
	on/stand-by LED if on, the device is in stand-by mode
<b>°C</b>	degree Celsius LED if on, the unit of measurement for temperature is degrees Celsius (parameter P2) if flashing, then the Energy Saving function is in operation (parameters r4 and i5)
<b>°F</b>	degree Fahrenheit LED if on, the unit of measurement for temperature is degrees Fahrenheit (parameter P2) if flashing, then the Energy Saving function is in operation (parameters r4 and i5)
	Multifunction LED <p><b>parameter u1 is set to 0 (i.e. the service controlled by the fourth output is the cabinet light)</b></p> if on, the cabinet light will have been switched on manually if flashing, the cabinet light will have been turned on remotely (parameter i0) <p><b>parameter u1 is set to 1, 4, 5, 6 or 7</b></p> if on, the service controlled by the fourth output will be turned on <p><b>parameter is set to 2 (i.e. the service controlled by the fourth output is the auxiliary output)</b></p> if on, the auxiliary output will have been turned on manually if flashing, the auxiliary output will have been turned on remotely (parameter i5) <p><b>parameter u1 is set to 3 (i.e. the service controlled by the fourth output is compressor 2)</b></p> if on, compressor 2 is on if flashing, compressor 2 delay is ongoing (parameter C9)
CODE	MEANING
<b>Loc</b>	the key and/or operational setpoint are blocked (parameter r3), refer to paragraph 2.1.1
<b>---</b>	the quantity for display is not available (e.g. the probe is absent)

#### 7 ALARMS

##### 7.1 Alarms

CODE	MEANING
<b>AL</b>	Minimum temperature alarm ( <b>HACCP alarm</b> ) Remedies: <ul style="list-style-type: none"> <li>check the alarm temperature</li> <li>check parameters A0, A1 and A2</li> </ul> Main consequences: <ul style="list-style-type: none"> <li>if parameter A0 is set to 0 or if parameter P4 is set to 1 and parameter A0 is set to 2, the device records the alarms, on condition that the instrument has stored no alarm of this type or on condition that the critical value is more critical than the one the instrument has stored</li> <li>if parameter u1 is set to 4, the alarm output will be activated</li> </ul>
<b>AH</b>	Maximum temperature alarm ( <b>HACCP alarm</b> ) Remedies: <ul style="list-style-type: none"> <li>check the alarm temperature</li> <li>check parameters A3, A4 and A5</li> </ul> Main consequences: <ul style="list-style-type: none"> <li>if parameter A3 is set to 0 or if parameter P4 is set to 1 and parameter A3 is set to 1, the device records the alarms, on condition that the instrument has stored no alarm of this type or on condition that the critical value is more critical than the one the instrument has stored</li> <li>if parameter u1 is set to 4, the alarm output will be activated</li> </ul>
<b>id</b>	Microport input alarm ( <b>HACCP alarm</b> ) Remedies: <ul style="list-style-type: none"> <li>check the causes which activated the input</li> <li>check parameters i0, i1 and i4</li> </ul> Main consequences: <ul style="list-style-type: none"> <li>the outcome set by parameter i0</li> <li>if parameter i4 is set to 1, the device records the alarms, on condition that the instrument has stored no alarm of this type or on condition that the critical value is more critical than the one the instrument has stored (however providing parameter i2 is not set to -1)</li> <li>if parameter u1 is set to 4, the alarm output will be activated</li> </ul>
<b>iA</b>	Input malfunction alarm (only if parameter P4 is set to 3) Remedies: <ul style="list-style-type: none"> <li>check the causes which activated the input</li> <li>check parameters i5 and i6</li> </ul> Main consequences: <ul style="list-style-type: none"> <li>if parameter i5 is set to 4, the device will continue to operate as normal</li> <li>if parameter i5 is set to 5, the compressor will be switched off</li> <li>if parameter u1 is set to 4, the alarm output will be activated</li> </ul>
<b>isd</b>	Device blocked alarm (only if parameter P4 is set to 3) Remedies: <ul style="list-style-type: none"> <li>check the causes which activated the input malfunction</li> <li>switch the device off then on, or disconnect the power supply</li> <li>check parameters i5, i6, i7, i8 and i9</li> </ul> Main consequences: <ul style="list-style-type: none"> <li>the regulators will be switched off</li> <li>if parameter u1 is set to 4, the alarm output will be activated</li> </ul>
<b>COH</b>	Condenser overheating alarm (only if parameter P4 is set to 3) Remedies: <ul style="list-style-type: none"> <li>check the condenser temperature</li> <li>check parameter C6</li> </ul> Main consequences: <ul style="list-style-type: none"> <li>if parameter u1 is set to 4, the alarm output will be activated</li> </ul>
<b>Csd</b>	Compressor blocked alarm (only if parameter P4 is set to 3) Remedies: <ul style="list-style-type: none"> <li>check the condenser temperature</li> <li>switch the device off and then on again: if on switching back on again the condenser temperature is still above the value established by parameter C7, it will be necessary to disconnect the power supply and clean the condenser</li> <li>check parameter C7</li> </ul> Main consequences: <ul style="list-style-type: none"> <li>the compressor and evaporator fan will be switched off</li> <li>if parameter u1 is set to 4, the alarm output will be activated</li> </ul>

When the cause that triggered the alarm has been resolved, the device will restore normal operation, except for the following alarm states:

- the device blocked alarm (code "isd") which requires the device be switched off or the power supply disconnected
- the compressor blocked alarm (code "Csd") which requires the device be switched off or the power supply disconnected.

**8 INTERNAL DIAGNOSTICS**

**8.1 Internal Diagnostics**

CODE	MEANING
<b>Pr1</b>	Cabinet probe error Remedies: <ul style="list-style-type: none"> <li>see parameter P0</li> <li>check probe integrity</li> <li>check probe-device connection</li> <li>check the cabinet temperature</li> </ul> Main consequences: <ul style="list-style-type: none"> <li>the activity of the compressor will depend on parameters C4 and C5</li> <li>defrosting will never be activated</li> <li>if parameter u1 is set to 4, the alarm output will be activated</li> <li>if parameter u1 is set to 5 or 6, the fourth output will be deactivated</li> </ul>
<b>Pr2</b>	Evaporator probe error Remedies: <ul style="list-style-type: none"> <li>the same as for the previous case, but in relation to the evaporator probe</li> </ul> Main consequences: <ul style="list-style-type: none"> <li>if parameter P3 is set to 1, defrosting will last for the duration established by parameter d3</li> <li>if parameter P3 is set to 1 and parameter d8 is set to 2, the device will operate as though parameter d8 was set to 0</li> <li>if parameter F0 is set to 3 or 4, the device will operate as though the parameter was set to 2</li> <li>if parameter u1 is set to 4, the alarm output will be activated</li> </ul>
<b>Pr3</b>	Auxiliary probe error (only if parameter P4 is set to 1 or 2) Remedies: <ul style="list-style-type: none"> <li>the same as for the previous case, but in relation to the auxiliary probe</li> </ul> Main consequences: <ul style="list-style-type: none"> <li>if parameter u1 is set to 4, the alarm output will be activated</li> </ul>

When the cause of the alarm is resolved, the device restores normal operation.

**9 TECHNICAL DATA**

**9.1 Technical data**

**Case:** grey self-extinguishing.  
**Front panel protection classification:** IP 65.  
**Connections (use copper conductors only):** screw terminal blocks (power supply, inputs and outputs), 6 pin connector (serial port; by request), 4 pin connector (to remote indicator; by request); spring extractable terminal blocks (power supply, inputs and outputs)  
**Operating temperature:** from 0 to 55°C (from 32 to 131°F, 10 ... 90% relative humidity, without condensation).  
**Power supply:** 12 VAC/DC (or 12-24 VAC/DC), 50/60 Hz, 3.5 VA (approximate) or 115 ... 230 VAC, 50/60 Hz, 5 VA (approximate).  
If the instrument is supplied at 115 ... 230 VAC, protect the power supply with a fuse rated 250 V, 1.25 A, 6.7 IZt.  
**Insulation class:** 2.  
**Alarm buzzer:** available by request.  
**Sensor inputs:** 2 (cabinet probe and evaporator probe) for PTC/NTC probes.  
**Digital inputs:** 1 (microport) for NA/NC contact (clean contact, 5 V, 1 mA); fourth input can be configured as sensor input (display probe or condenser probe, for PTC/NTC probes) or digital input (multifunction, clean contact, 5 V, 1 mA).  
**Sensor range:** from -50.0 to 150.0°C (from -50 to 300°F) for PTC probes, from -40.0 to 105.0°C (from -40 to 220°F) for NTC probes.  
**Sensitivity:** 0.1°C/1°C/1°F.  
**Digital outputs:** 4 relays:  

- compressor relay:** 16 A res. @ 250 VAC, 5 FLA, 30 LRA (exchange contacts)
- defrost relay:** 8 A res. @ 250 VAC, 2 FLA, 12 LRA (exchange contacts)
- evaporator fan relay:** 8 A res. @ 250 VAC, 2 FLA, 12 LRA (NA contacts)
- fourth output:** 8 A res. @ 250 VAC, 2 FLA, 12 LRA (exchange contacts).

**The maximum permitted current on loads is 10 A.**

**Serial port:** port for communicating with the monitoring system (by means of a serial interface, via TTL, using the MODBUS communication protocol) or with the programming key; by request.

**Other communication ports:** port for communicating with the remote indicator; by request.

PT • 47/10

**10 OPERATIONAL SETPOINT AND CONFIGURATION PARAMETERSE**

**10.1 Operational setpoint**

	MIN.	MAX.	U.O.M.	DEF.	OPERATIONAL SETPOINT
r1	r2		°C/°F (1)	0,0	operational setpoint

**10.2 Configuration parameters**

PARAM.	MIN.	MAX.	U.O.M.	DEF.	OPERATIONAL SETPOINT
SP	r1	r2	°C/°F (1)	0,0	operational setpoint
PARAM.	MIN.	MAX.	U.O.M.	DEF.	INGRESSI DI MISURA
CA1	-25,0	25,0	°C/°F (1)	0,0	cabinet probe offset
CA2	-25,0	25,0	°C/°F (1)	0,0	evaporator probe offset
CA3	-25,0	25,0	°C/°F (1)	0,0	auxiliary probe offset (only if P4 = 1 or 2)
P0	0	1	----	1	probe type 0 = PTC 1 = NTC
P1	0	1	----	1	degree Celsius decimal point (for the quantity displayed during normal operation) 1 = YES
P2	0	1	----	0	unit of temperature measurement (2) 0 = °C 1 = °F
P3	0	2	----	1	evaporator probe function 0 = no probe 1 = defrosting probe and evaporator fan thermostat probe 2 = evaporator fan thermostat probe
P4	0	3	----	3	fourth input function 0 = no probe 1 = sensor input (auxiliary probe, display probe) 2 = sensor input (auxiliary probe, condenser probe) 3 = digital input (multifunction input)
P5	0	4	----	0	quantity displayed during normal operation 0 = cabinet temperature 1 = operational setpoint 2 = evaporator temperature 3 = "cabinet temperature - evaporator temperature" 4 = temperature detected by the auxiliary probe (only if P4 = 1 or 2)
P6	0	4	----	0	quantity displayed by the remote indicator 0 = cabinet temperature 1 = operational setpoint 2 = evaporator temperature 3 = "cabinet temperature - evaporator temperature" 4 = temperature detected by the auxiliary probe (only if P4 = 1 or 2)
PARAM.	MIN.	MAX.	U.O.M.	DEF.	MAIN CONTROLLER
r0	0,1	15,0	°C/°F (1)	2,0	operational setpoint differential
r1	-99,0	r2	°C/°F (1)	-50,0	minimum operational setpoint
r2	r1	99,0	°C/°F (1)	50,0	maximum operational setpoint
r3	0	1	----	0	block operational setpoint change (with the procedure indicated in paragraph 3.1) 1 = YES
r4	0,0	99,0	°C/°F (1)	0,0	temperature increase during Energy Saving function (only if P4 = 3 and i5 = 2 or 3)
PARAM.	MIN.	MAX.	U.O.M.	DEF.	COMPRESSOR PROTECTIONS (3)
C0	0	240	min	0	compressor delay from device power on (4)
C1	0	240	min	5	minimum time between two successive compressor operations; also compressor delay on resolution of cabinet probe error (5) (6)
C2	0	240	min	3	minimum compressor shut-down time (5)
C3	0	240	s	0	minimum compressor start-up time
C4	0	240	min	10	duration of compressor shut-down during cabinet probe error; see also C5

C5	0	240	min	10	duration of compressor start-up during cabinet probe error; see also C4
C6	0,0	200,0	°C/°F (1)	80,0	condenser temperature above which the condenser overheating alarm is activated (only if P4 = 2) (7)
C7	0,0	200,0	°C/°F (1)	90,0	condenser temperature above which the compressor block alarm is activated (only if P4 = 2)
C8	0	15	min	1	compressor block alarm delay (only if P4 = 2) (8)
C9	0	120	s	5	compressor 2 delay from power up of compressor 1 (only if u1 = 3)
C10	0	9999	h	1000	number of hours of compressor operation above which maintenance request is indicated 0 = no function
PARAM.	MIN.	MAX.	U.O.M.	DEF.	DEFROSTING
d0	0	99	h	8	defrost interval; see also d8 (9) 0 = regular periodic defrosting will never be activated
d1	0	1	----	0	type of defrosting 0 = electric 1 = hot gas
d2	-99,0	99,0	°C/°F (1)	2,0	defrost end temperature (only if P3 = 1)
d3	0	99	min	30	defrost duration if P3 = 0 or 2; maximum defrost duration if P3 = 1 0 = defrosting will never be activated
d4	0	1	----	0	defrosting at device power on (4) 1 = YES
d5	0	99	min	0	defrost delay from device power on (only if d4 = 1); see also i5 (4)
d6	0	1	----	1	temperature displayed during defrosting (only if P5 = 0) 0 = cabinet temperature 1 = if, on activation of defrosting the cabinet temperature is below the "operational setpoint + r0", at most "operational setpoint + r0"; if on activation of defrosting the cabinet temperature is above the "operational setpoint + r0", at most the cabinet temperature at activation of defrosting (10)
d7	0	15	min	2	drip-drain duration
d8	0	2	----	0	method of activation of defrosting 0 = defrosting will be activated when the device has been left running for the length of time d0 1 = defrosting will be activated when the compressor has been running for the length of time d0 2 = defrosting will be activated when the evaporator temperature remains below the temperature set by d9 for the amount of time et by d0 (11)
d9	-99,0	99,0	°C/°F (1)	0,0	the evaporator temperature above which the defrost interval count is suspended (only if d8 = 2)
dA	0	99	min	0	minimum compressor on duration on activation of defrosting so that they may be activated (only if d1 = 1) (12)
PARAM.	MIN.	MAX.	U.O.M.	DEF.	TEMPERATURE ALARMS
A0	0	2	----	0	temperature associated with the minimum temperature alarm 0 = cabinet temperature 1 = evaporator temperature (13) 2 = temperature detected by the auxiliary probe (only if P4 = 1 or 2) (14)
A1	-99,0	99,0	°C/°F (1)	-10,0	the temperature below which the minimum temperature alarm is activated; see also A0 and A2 (7)
A2	0	2	----	1	minimum temperature alarm type 0 = no alarm 1 = in relation to the operational setpoint (i.e. "operational setpoint - A1"; consider A1 to be without sign) 2 = absolute (i.e. A1)
A3	0	1	----	0	temperature associated with the maximum temperature alarm 0 = cabinet temperature 1 = temperature detected by the auxiliary probe (only if P4 = 1 or 2) (14)
A4	-99,0	99,0	°C/°F (1)	10,0	the temperature above which the maximum temperature alarm is activated; see also A3 and A5 (7)
A5	0	2	----	1	maximum temperature alarm type 0 = no alarm 1 = in relation to the operational setpoint (i.e. "operational setpoint + A4"; consider A4 to be without sign) 2 = absolute (i.e. A4)
A6	0	240	min	120	maximum temperature alarm delay on switching on device (only if A3 = 0 or if P4 = 1 and A3 = 1) (4)
A7	0	240	min	15	temperature alarm delay
A8	0	240	min	15	maximum temperature alarm delay on conclusion of evaporator fan stop (only if A3 = 0 or if P4 = 1 and A3 = 1) (15)
A9	0	240	min	15	maximum temperature alarm delay on microport input deactivation (only if A3 = 0 or if P4 = 1 and A3 = 1) (16)
PARAM.	MIN.	MAX.	U.O.M.	DEF.	EVAPORATOR FAN
F0	0	4	----	1	evaporator fan activity during normal operation 0 = off 1 = on 2 = in parallel with compressor 3 = dependent on F1 (17) 4 = off if the compressor is off, dependent on F1 if the compressor is on (17)
F1	-99,0	99,0	°C/°F (1)	-1,0	evaporator temperature above which the evaporator fan is switched off (only if F0 = 3 or 4) (7)
F2	0	2	----	0	evaporator fan activity during defrosting and drip-draining 0 = off 1 = on (it is recommended that parameter d7 be set to 0) 2 = dependent on F0
F3	0	15	min	2	evaporator fan stop duration
PARAM.	MIN.	MAX.	U.O.M.	DEF.	DIGITAL INPUTS
i0	0	5	----	1	effect caused by activation of microport input; see also i4 0 = no effect 1 = the cabinet light will be switched on (only if u1 = 0, until the input is deactivated) 2 = the evaporator fan will be switched off (for up to the length of time set by i3 or until the input is deactivated) 3 = the compressor and evaporator fan will be switched off (for up to the length of time set by i3 or until the input is deactivated) (18) 4 = the evaporator fan will be switched off (for up to the length of time set by i3 or until the input is deactivated) and the cabinet light will be switched on (only if u1 = 0, until the input is deactivated) 5 = the compressor and evaporator fan will be switched off (for up to the length of time set by i3 or until the input is deactivated) and the cabinet light will be switched on (only if u1 = 0, until the input is deactivated) (18)
i1	0	1	----	0	microport input contact type 0 = NA (input active with contact closed) 1 = NC (input active with contact open)
i2	-1	120	min	30	microport input alarm signal delay -1 = the alarm will not be reported
i3	-1	120	min	15	maximum duration of the effect caused by activation of the microport input on the compressor and on the evaporator fan -1 = the effect will last until the input will be disabled
i4	0	1	----	0	recording of microport input alarm (19) 1 = YES
i5	0	7	----	4	effect caused by activation of the multifunction input (only if P4 = 3) 0 = no effect 1 = <u>DEFROST SYNCHRONISATION</u> - after the period of time set by d5 defrosting will be activated 2 = <u>ACTIVATION OF ENERGY SAVING FUNCTION</u> - the Energy Saving function will be activated (until the input is deactivated); see also r4 3 = <u>CLOSURE OF THE AWNING</u> - the cabinet light will be turned off (only if u1 = 0 and only if switched on manually) and the Energy Saving function will be activated (until the input is deactivated); see also r4 4 = <u>ALARM ACTIVATION</u> - after the amount of time set by i7 the display will flash the code "iA" and the buzzer will be activated (until the input is deactivated) 5 = <u>TRIPPING THE PRESSURE SWITCH</u> - the compressor will be switched off, the display will flash the code "iA" and the buzzer will be activated (until the input is deactivated); see also i7, i8 and i9

					6 = <b>TURNING ON THE AUXILIARY OUTPUT</b> - the auxiliary output will be turned on (only if u1 = 2, until the input is deactivated) 7 = <b>SWITCHING OFF THE DEVICE</b> - the device will switch to stand-by mode (until the input is deactivated)
i6	0	1	----	0	type of multifunction input contact (only if P4 = 3) 0 = NA (input active with contact closed) 1 = NC (input active with contact open)
i7	0	120	min	0	if i5 = 4, delayed multifunction input alarm notification (only if P4 = 3) if i5 = 5, delayed multifunction input deactivation compressor delay (only if P4 = 3) (20)
i8	0	15	----	0	number of multifunction input alarms such as to cause device block alarm (only if P4 = 3 and i5 = 5) 0 = no alarm
i9	1	999	min	240	time that must elapse without multifunction input alarms so that the alarm counter is zeroed (only if P4 = 3 and i5 = 5)
PARAM.	MIN.	MAX.	U.O.M.	DEF.	DIGITAL OUTPUTS
u1	0	7	----	0	service controlled by the fourth output (21) 0 = <b>CABINET LIGHT</b> - in this case, the important factors are: the key  , parameters i0, i5 and u2 1 = <b>DEMISTING HEATER</b> - in this case, the important factors are: the key  and parameter u6 2 = <b>AUXILIARY OUTPUT</b> - in this case, the important factors are: the key  , parameters i5 and u2 3 = <b>COMPRESSOR 2</b> - in this case, the important factor is parameter C9 4 = <b>ALARM OUTPUT</b> - the output is activated during an alarm and during an error; in this case the important factors are parameters u3 and u4 5 = <b>DOOR ELEMENT</b> - in this case the important factor is parameter u5 6 = <b>EVAPORATOR VALVE</b> - in this case the important factors are parameters u7 and u8 7 = <b>DEFROST SYNCHRONISATION</b> - the output works in parallel with the defrost output; in this case the important parameter is factor i5 (22) (23) enabling cabinet light or auxiliary
u2	0	1	----	0	enables manual switching on/off of the cabinet light or auxiliary output while in stand-by mode (only if u1 = 0 or 2) (24) 1 = YES
u3	0	1	----	1	alarm output polarity (only if u1 = 4) 0 = disabled during normal operation (the contact between terminals 6 and 7 will be open) and activated during an alarm and during an error (the contact between terminals 6 and 7 will be closed) 1 = activated during normal operation (the contact between terminals 6 and 7 will be closed) and disabled during an alarm and during an error (the contact between terminals 6 and 7 will be open)
u4	0	1	----	0	enable alarm output deactivation with muting of buzzer (only if u1 = 4) 1 = YES
u5	-99,0	99,0	°C/°F (1)	-1,0	cabinet temperature above which the door element is switched off (only if u1 = 5) (7)
u6	1	120	min	5	demisting heating duration (only if u1 = 1)
u7	0,0	99,0	°C/°F (1)	2,0	cabinet temperature below which the evaporator valve is deactivated (in relation to the operational setpoint, i.e. the "operational setpoint + u7") (only if u1 = 6) (7)
u8	0	1	----	0	evaporator valve contact type (only if u1 = 6) 0 = NA (valve active with contact closed) 1 = NC (valve active with contact open)
PARAM.	MIN.	MAX.	U.O.M.	DEF.	SERIAL NETWORK (MODBUS)
LA	1	247	----	247	device address
Lb	0	3	----	2	baud rate (0 = 2.400 baud, 1 = 4.800 baud, 2 = 9.600 baud, 3 = 19.200 baud)
LP	0	2	----	2	parity 0 = none (no parity) 1 = odd 2 = even
PARAM.	MIN.	MAX.	U.O.M.	DEF.	RESERVED
E9	0	1	----	1	reserved

- (1) the unit of measurement depends on parameter P2
- (2) set appropriate regulator parameters after altering parameter P2
- (3) if parameter u1 is set to 3, the service controlled by the fourth output will be compressor 2: compressor 1 and compressor 2 are referred to as "compressor"; compressor 2 operates in parallel with compressor 1, regardless of parameter C9
- (4) the parameter is even effective after power supply interruption, such as when the device is switched on
- (5) the time period established by the parameter is counted even while in stand-by mode
- (6) if parameter C1 is set to 0, the cabinet probe error resolution delay will be 2 minutes in any case
- (7) the parameter differential is 2.0°C/4°F
- (8) if, on device start-up, the condenser temperature is already above that established by parameter C7, parameter C8 will have no effect
- (9) the device stores the defrost interval count every 30 minutes; altering parameter d0 has the effect of concluding the previous defrost interval or manual defrost activation
- (10) the display is restored to normal operation when, the evaporator fan stop is concluded, the cabinet temperature drops below that which blocked the display (or if a temperature alarm occurs)
- (11) if parameter P3 is set to 0 or 2, the device will operate as though parameter d8 was set to 0
- (12) if, on defrost activation, the compressor on duration is less than the time established by parameter dA, the compressor will remain on for the fraction of time required to complete it
- (13) if parameter P3 is set to 0, the device will operate as though parameter A0 was set to 0, but will not record the alarm
- (14) if parameter P4 is set to 0 or 3, the device will operate as though the parameter was set to 0, but will not record the alarm
- (15) during defrosting, drip draining and ventilator fan stop, there are no temperature alarms, if said occur following defrost activation
- (16) there is no maximum temperature alarm while microport input is enabled, if occurring after input activation
- (17) if parameter P3 is set to 0, the device will operate as though parameter F0 was set to 2
- (18) the compressor is switched off 10 s after activation of the input; if the input is activated during defrosting or evaporator fan stop, activation will have no effect on the compressor
- (19) the device records alarms occurring after the time established by parameter i2; if parameter i2 is set to -1, the device does not record the alarms
- (20) ensure that the time established by parameter i7 s less than that established by parameter i9
- (21) in order to avoid damage to the service connected, modify the parameter while in stand-by mode
- (22) if the fourth output terminals are connected to the fourth input terminals of several devices, it will be possible to synchronise defrosting (providing that in each device, parameter P4 is set to 3, that parameter i5 is set to 1 and parameter u1 is set to 7); in this case, drip-drain duration counting starts when defrosting of the last device is concluded
- (23) it is recommended that parameter d7 for each device be set to the same value (different from 0 min); similarly, it is recommended to set parameter F3 for each device to the same value
- (24) if parameter u2 is set to 0, switching off the device may cause switching off of the cabinet light or the auxiliary output (the service will remain off on subsequent switching on of the device); if parameter u2 is set to 1, switching off the device does not cause switching off of the cabinet light or the auxiliary output (the service remains on on subsequent switching on of the device).

 The device must be disposed of in accordance with local regulations pertaining to the collection of electrical and electronic appliances.